

COLUMN SCHEDULE			
MARK	COLUMN SIZE	(BASE) CONN. & FASTENER	UPLIFT(LB)
C1	(3) 2 x 4 #2 SFF	(4) - 16d TOENAILS	0
C2	(3) 2 x 4 #2 SFF	DTT22 W/ 1/2" WEDGE ANCHOR* & (8) 1/4" X 1 1/2" SDS SCREWS	2145
C3	(3) 2 x 4 SYP #1 OR	(4) - 16d TOENAILS	0
C4	(4) 2 x 4 SFF #2	DTT22 W/ 1/2" WEDGE ANCHOR* & (8) 1/4" X 1 1/2" SDS SCREWS	2145
C5	4 x 4 P.T.#2 SYP POST	ABU44 W/ 5/8" ATR** & (12) - 16d NAILS	G = 6665 U = 2200
C6	6 x 6 P.T.#2 SYP POST	ABU66 W/ 5/8" ATR** & (12) - 16d NAILS	G = 12000 U = 2300
C7	8 x 8 P.T.#2 SYP POST	ABU88 W/ (2) - 5/8" ATR** & (18) - 16d NAILS	G = 24335 U = 2320
C8	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU5-SDS2.5 W/ (14) 1/4" x 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645
C9	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU5-SDS2.5 W/ (14) 1/4" x 2 1/2" SDS WS & 5/8" EPOXY ANCHOR, OR ATR**	5645
C10	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU5-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	6970
C11	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU5-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870
C12	3.5 x 3.5 P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU5-SDS2.5 W/ (20) 1/4" x 2 1/2" SDS WS & 7/8" EPOXY ANCHOR, OR ATR**	7870
C13	5.25" x 7" P.L. 1.8E Fb=2400 PSI (WOLMANIZED IF EXT.)	HDU8-SDS2.5 W/ 7/8" ATR AND (20) 1/4" x 1 1/2" SDS WOOD SCREWS	7870

GENERAL COLUMN NOTES

- SEE FLOOR PLAN FOR WALL WIDTH. STUD PACKS TO MATCH WALL WIDTH UNO.
- ALL STRUCTURAL LUMBER TO BE SYP #1 OR SFF #2 UNO ON PLAN.
- NAIL BUILT UP STUDS PER DETAIL WF37.
- MINIMUM GOLT EMBEDMENT:
5" EMBEDMENT FOR 1/2" ATR
8" EMBEDMENT FOR 5/8" ATR
8" EMBEDMENT FOR 7/8" ATR
- IF (C) COLUMN IS INDICATED ON SECOND FLOOR, THE BASE CONNECTION IS NOT REQUIRED. SEE INDICATED CALL OUT ON PLAN FOR ATTACHMENT.
- SEE WOOD CONSTRUCTION NOTE #4 ON COVER SHEET FOR CORROSION INFORMATION.
- SAME NOMINAL SIZE PARALLEL COLUMNS (1.8E) MAY BE SUBSTITUTED FOR ANY P.T. SYP POST NOTED IN THE PLANS.**

COMMON NAIL vs. PNEUMATIC GUN NAILS:			
COMMON NAIL	DI. / LENGTH	PNEUMATIC GUN NAIL DIA./LENGTH	COMMON vs. GUN APPLICATION
8d	0.131" X 2 1/2"	0.131" X 2 1/2"	SEE PLAN RING SHANK ON ROOF SHEATHING ROOF & WALLS
10d OR 12d	0.148" X 3"	0.131" X 3"	SEE PLAN BLOCKING & TOE NAILS & TOP PLATE
12d	0.148" X 3 1/4"	0.131" X 3 1/4"	8" O.C.(COMMON) 8" O.C.(GUN NAIL)
10s	0.148" X 3"	0.131" X 3"	8" O.C.(COMMON) 8" O.C.(GUN NAIL)
16d	0.162" X 3 1/2"	0.131" X 3 1/4"	(2) 16d(COMMON) (3) 16d (GUN NAILS) SEE PLAN

BEAM SCHEDULE

MARK	BEAM SIZE	CONNECTIONS
BM1	(2) - 2 x 8 #2 SYP W/ 7/16" OSB FLITCH PLATE. NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA18 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM2	(2) - 2 x 10 #2 SYP W/ 7/16" OSB FLITCH PLATE. NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM3	(2) - 2 x 12 #2 SYP W/ 7/16" OSB FLITCH PLATE. NAIL BEAM TOGETHER USING (2) ROWS OF 12d NAILS @ 12" O.C. TYP EACH SIDE	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM4	(2) - 1 3/4" x 11 1/4" LVL 2.0E Fb=2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE.	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM5	(2) - 1 3/4" x 11 7/8" LVL 2.0E Fb=2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE.	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.
BM6	(2) - 1 3/4" x 16" LVL 2.0E Fb=2600 PSI. NAIL BEAM TOGETHER USING (2) ROWS 1/4" x 3 1/2" SDS WOOD SCREWS @ 16" O.C. TYP. EACH SIDE.	CONNECTION: PROVIDE (2) SIMPSON LSTA24 OR (2) SIMPSON HTS20 TO WOOD POST OR (2) SIMPSON HETA16 TO CMU COL. U.N.O. ON ROOF PLAN.

GENERAL BEAM NOTES

- VERIFY WITH PLAN CORRECT LENGTH OF BEAMS REQUIRED (MIN. 4" BEARING EACH END).
- SEE PLAN FOR TOP OR BOTTOM OF BEAM INDICATIONS.
- BEAMS ARE NOT TO BE DRILLED OR NOTCHED IN ANY WAY WITHOUT WRITTEN APPROVAL FROM THE E.O.R.

HEADER SCHEDULE

(IF USED, SEE DET. "HDR" ON SHEET S 2 FOR ENERGY STAR INSULATION ON HEADERS)


MARK	HEADER SIZE	REMARKS
H1	(2) - 2X6 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H2	(2) - 2X8 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H3	(2) - 2X10 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H4	(2) - 2X12 #2 SYP W/ 1/2" FLITCH PLATE	SEE GENERAL HEADER NOTE #5 THIS SHEET
H5	(2) - 1 3/4" X 11 1/4" LVL 2.0E Fb=2600 PSI	ATTACH TOGETHER W/ (2) ROWS 1/4" X 3 1/2" SDS WD SCREWS @ 16" O.C. TYP. EACH SIDE
H6	(2) - 1 3/4" X 9 1/4" LVL 2.0E Fb=2600 PSI	ATTACH TOGETHER W/ (3) ROWS 1/4" X 3 1/2" SDS WD SCREWS @ 16" O.C. TYP. EACH SIDE

HEADER SUPPORT NO. OF JACKS & STUDS REQ. AT OPENINGS

OPENING SIZE	2x4 WALL		2x6 OR 2x8 WALL	
	JACKS EA. END	KINGS EA. END	JACKS EA. END	KINGS EA. END
1'-0" - 3'-11"	(1)	(2)	(1)	(2)
4'-0" - 9'-11"	(2)	(3)	(2)	(3)
10'-0" - 16'-0"	(3)	(4)	(3)	(4)

GENERAL HEADER NOTES


- VERIFY W/ PLAN CORRECT LENGTH OF HEADER REQUIRED
- IF HEADER IS ON THE 1st FLOOR SEE PLAN FOR BEARING WALL TYPE AND FOLLOW INSTRUCTIONS WITHIN BEARING WALL SCHEDULE FOR REQUIRED CORRECTIONS AND ON PLAN.
- IF HEADER IS ON THE 2nd FLOOR SEE PLAN FOR INDICATED HEADER CONNECTION FOR REQUIRED CONNECTIONS.
- ALL HEADER JACK AND KING STUDS SHALL BE FASTENED TO EACH PER DETAIL WF37.
- FASTEN ALL MULTI-PLY HEADERS TOGETHER W/ (2) ROWS 12d COMMON NAILS AT 12" o.c. ALONG EACH EDGE OR (3) ROWS IF 2x10 OR LARGER.
- FASTEN ALL HEADERS TO KING STUDS WITH (3) 12d TOENAILS PER SIDE
- IF HEADER IS NOT SPECIFIED CONTACT E.O.R.

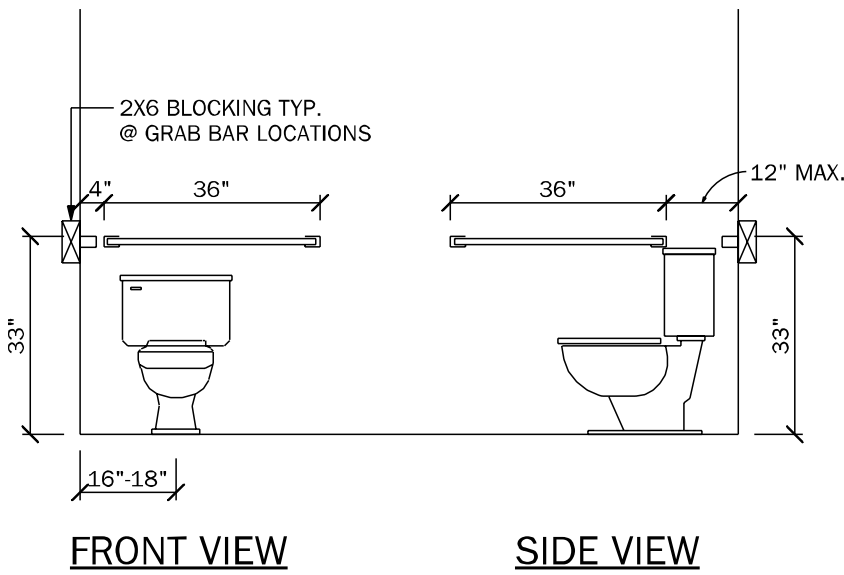


FRONT VIEW

SIDE VIEW

TYP.	GRAB BAR LOCATIONS DETAIL	N.T.S.
------	---------------------------	--------

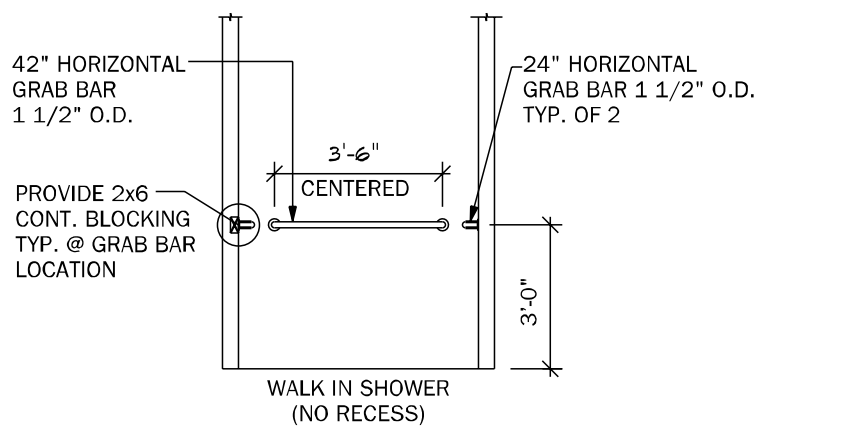

TYP. HANDICAPPED SHOWER/TUB BLOCKING DET.

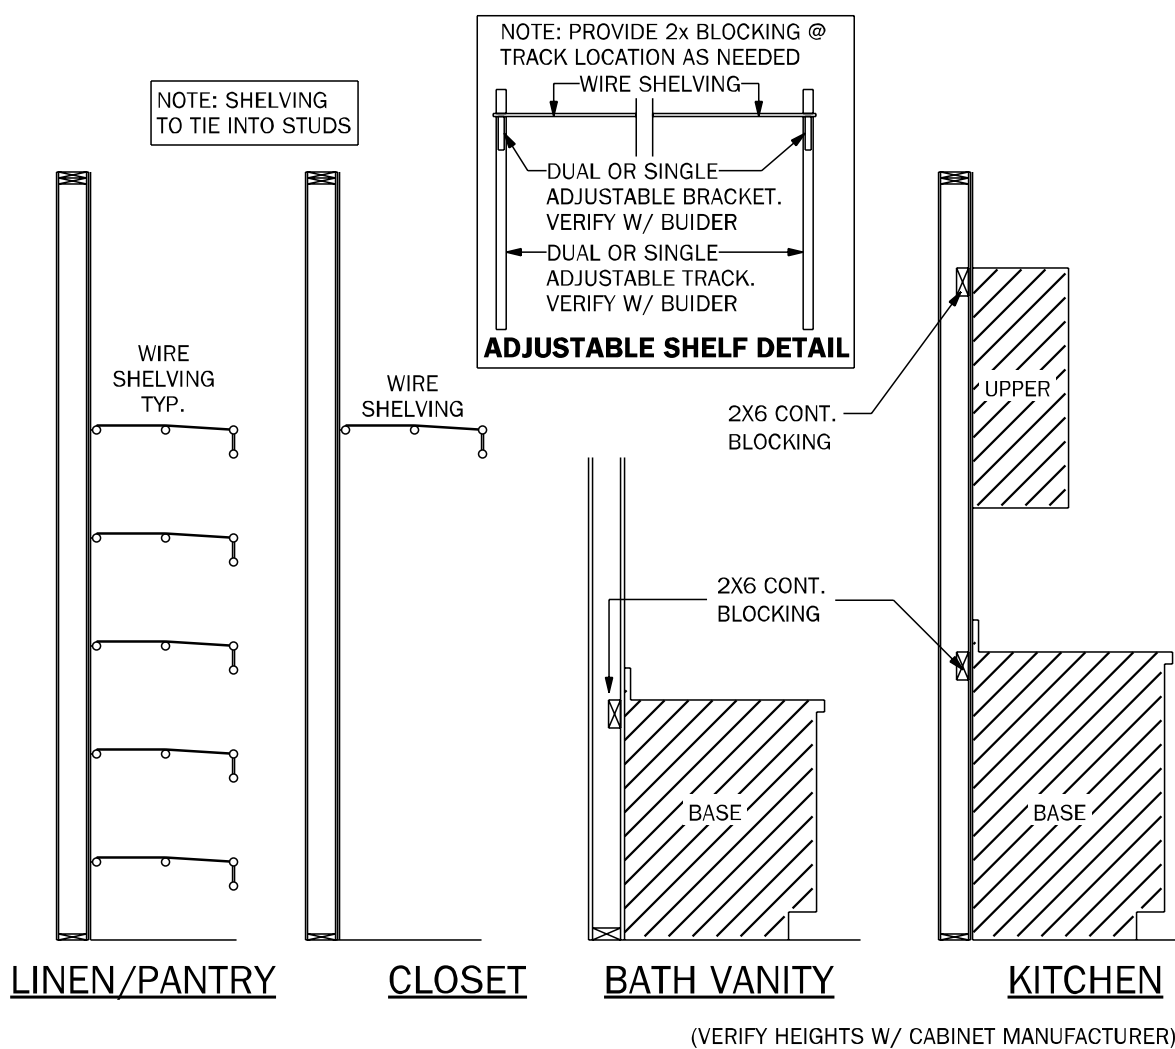


LINEN/PANTRY

CLOSET

BATH VANITY

KITCHEN

TYP. CABINET/SHELF DETAIL N.T.S.

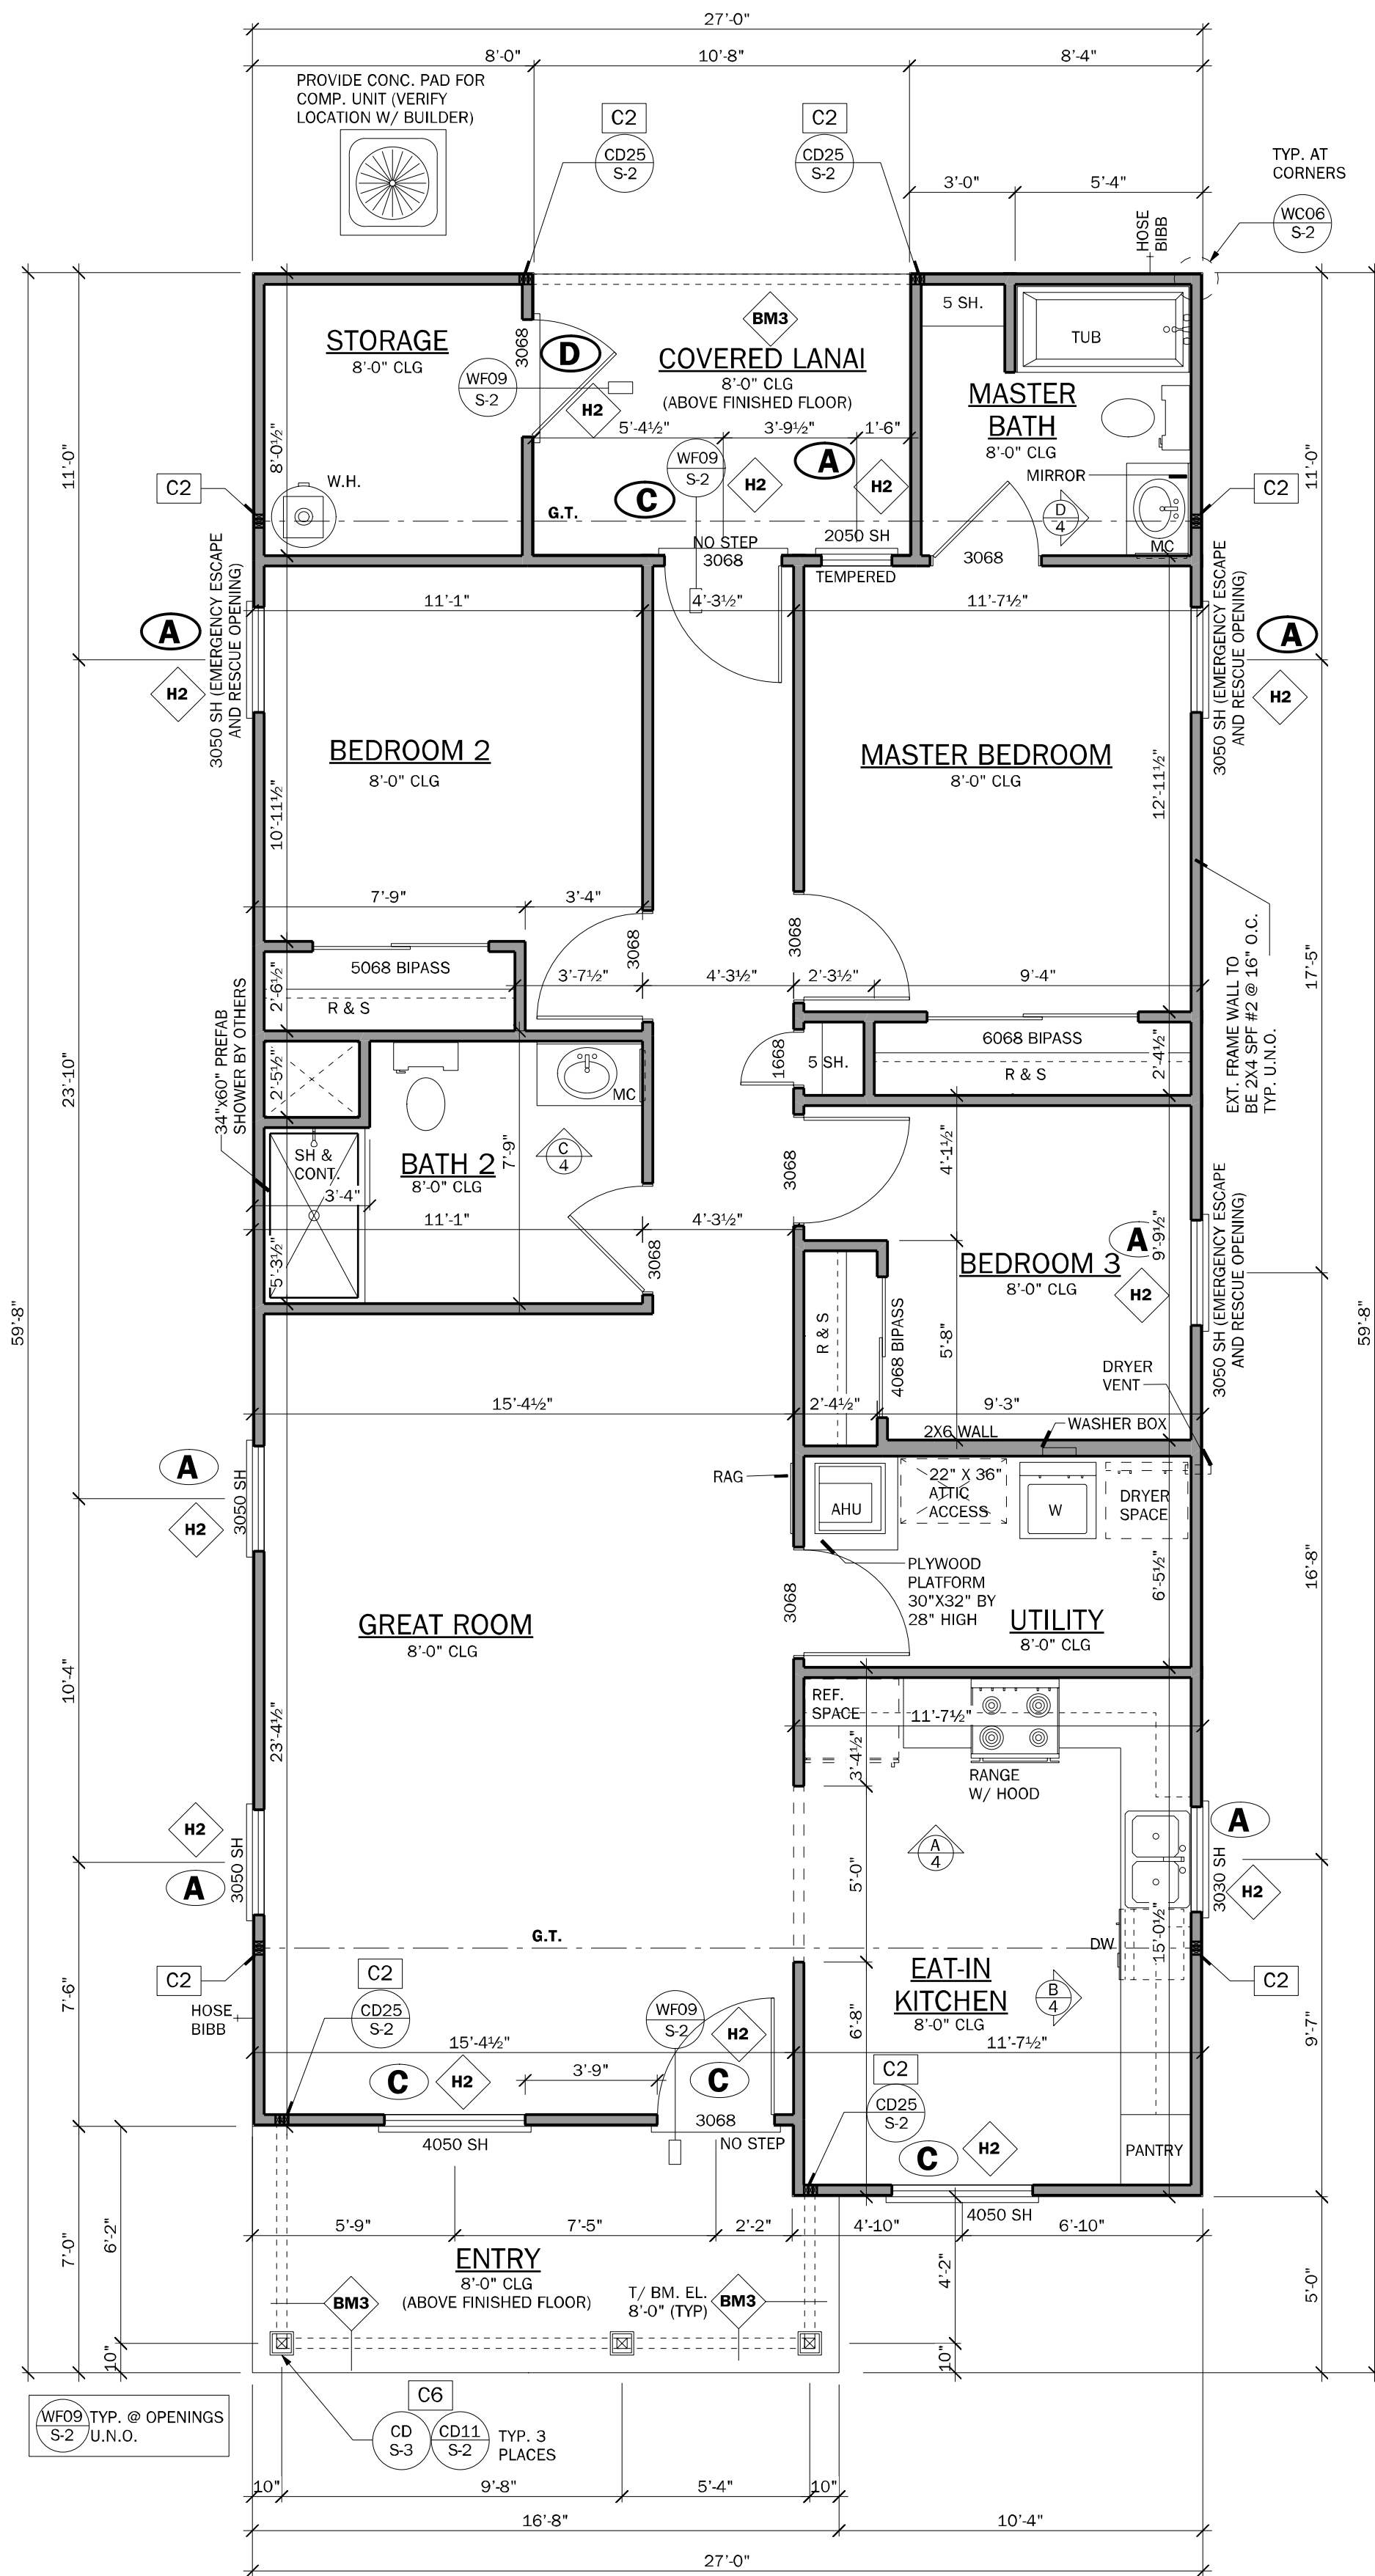

FLOOR PLAN

SCALE: 1/4" = 1'-0"

NOTE:
INDICATES OPENINGS WIND PRESSURES. SEE WIND LOADING CRITERIA ON COVER SHEET FOR INFORMATION.

WALL LEGEND

- FRAMED WALL
- BEARING FRAME WALL
- FRAMED WALL W/ BRICK VENEER
- FRAMED WALL W/ SIDING OR STUCCO

GENERAL NOTES

- R302.6 (table 302.6) If water based ceiling texture material is used, Provide 1/2" gypsum board for 16" O.C. Framing, or 5/8" gypsum board for 24" O.C. Framing. Note 1/2" sag-resistant gypsum board may be used 1 I.O. 5/8" gypsum board. 5/8" type "X" gypsum board must be installed on garage ceiling beneath habitable room(s).
- R302.5.2 Duct Penetration. Ducts in the garage and ducts penetrating the walls or ceilings separating the dwelling from the garage shall be constructed of a minimum No. 26 gage (0.48 mm) sheet steel, 1 inch minimum rigid nonmetallic class 0 or class 1 duct board, or other approved material and shall not have openings into the garage.
- R302.5.1 Door from garage into house must be a minimum 1 3/8" solid wood door, solid or honeycombcore steel door, or 20 Minute fire rated door.
- R302.7 Enclosed space under stairs that is accessed by a door or access panel shall have walls, under-stair surface and any soffits protected on the enclosed side with 1/2" gypsum board.
- Outdoor swimming pools shall be provided with a barrier complying with R4501.17.1.1 through R4501.17.1.14.
- Bathroom exhaust fans must vent to the exterior of the building, exhaust to attic space and soffits is not acceptable. Ventilation shall be permitted to exit through the soffit if solid soffit is installed 5'-0" on each side of the venting.
- R302.6 The garage shall be separated from the residence and it's attic as required by Table R302.6. From the residence and attics by not less than 1/2-inch (12.7mm) gypsum board applied to the garage side. Garage beneath rooms shall be separated from all habitable rooms above by not less than 5/8 inch (15.9mm) type X gypsum board or equivalent. Where the separation is a floor-ceiling assembly, the structure supporting the separation shall also be protected by not less than 1/2 inch (12.7mm) gypsum board or equivalent.
- R312.2 Window sills. In dwelling units, where the bottom of the clear opening of an operable window opening is located less than 24 inches (610 mm) above the finished floor and greater than 72 inches (1829 mm) above the finished grade or other surface below on the exterior of the building, the operable window shall comply with one of the following:
 - Operable windows with openings that will not allow a 4-inch diameter (102 mm) sphere to pass through the opening where the opening is in its largest opened position.
 - Operable windows that are provided with window fall prevention devices that comply with ASTM F2090.
 - Operable windows that are provided with window opening control devices that comply with Section R312.2.2.
- R308.4.2 All windows within 2'-0" of doors and in shower or tub areas will be safety tempered glass.
- EC: R402.2.4 Vertical or horizontal access doors from conditioned spaces to unconditioned spaces such as attics and crawl spaces shall be weatherstripped and insulated to a level equivalent to the insulation on the surrounding surfaces.
- M1502.4.5 Duct length
The maximum allowable exhaust duct length shall be determined by one of the methods specified in sections M1502.4.5.1 through M1502.4.5.3
M1502.3 Duct termination
Exhaust ducts shall terminate on the outside of the building. Exhaust duct terminations shall be in accordance with the dryer manufacturer's installation instructions. If the manufacturer's instructions do not specify a termination location, the exhaust duct shall terminate not less than 3 feet (914 mm) in any direction from openings into buildings, including openings in ventilated soffits. Exhaust duct terminations shall be equipped with a backdraft damper. Screens shall not be installed at the duct termination.
- Porch Ceilings: (See plan for the following options)
Option 1. Gypsum:
1/2" exterior gypsum soffit board shall be attached to all framing members with 2x blocking provided at perimeter and panel edges.
The gypsum board shall be attached w/ Type "W" 1 1/2" drywall screws at 8" O.C. in filed and edges.
Option 2. Plaster Base:
7/16" OSB on underside of roof trusses shall be attached to all framing members with 2x blocking provided at perimeter and panel edges. The OSB shall be attached w/ 8d nails at 6" O.C. field and 4" O.C. at edges or 7d screw shank 3" O.C. field and 4" edges.
- Energy Code Compliance Path is Performance Based Path. Code cycle is FBC 2023 8th Edition.

AREA TABULATION

LIVING AREA	1,292 SQ. FT.
STORAGE	64 SQ. FT.
PORCH ENTRY	114 SQ. FT.
COVERED LANAI	86 SQ. FT.
TOTAL UNDER ROOF	1,556 SQ. FT.



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750

100% Employee Owned
myTSHome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/17/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal by United States and International law.



Builder:


CD:	Community:	Plan Name:	The DROSTE
UNIT:		Project Address:	
BLK:		Client No.:	

Project No:
25-06831

Sheet No:


2

FLOOR PLAN

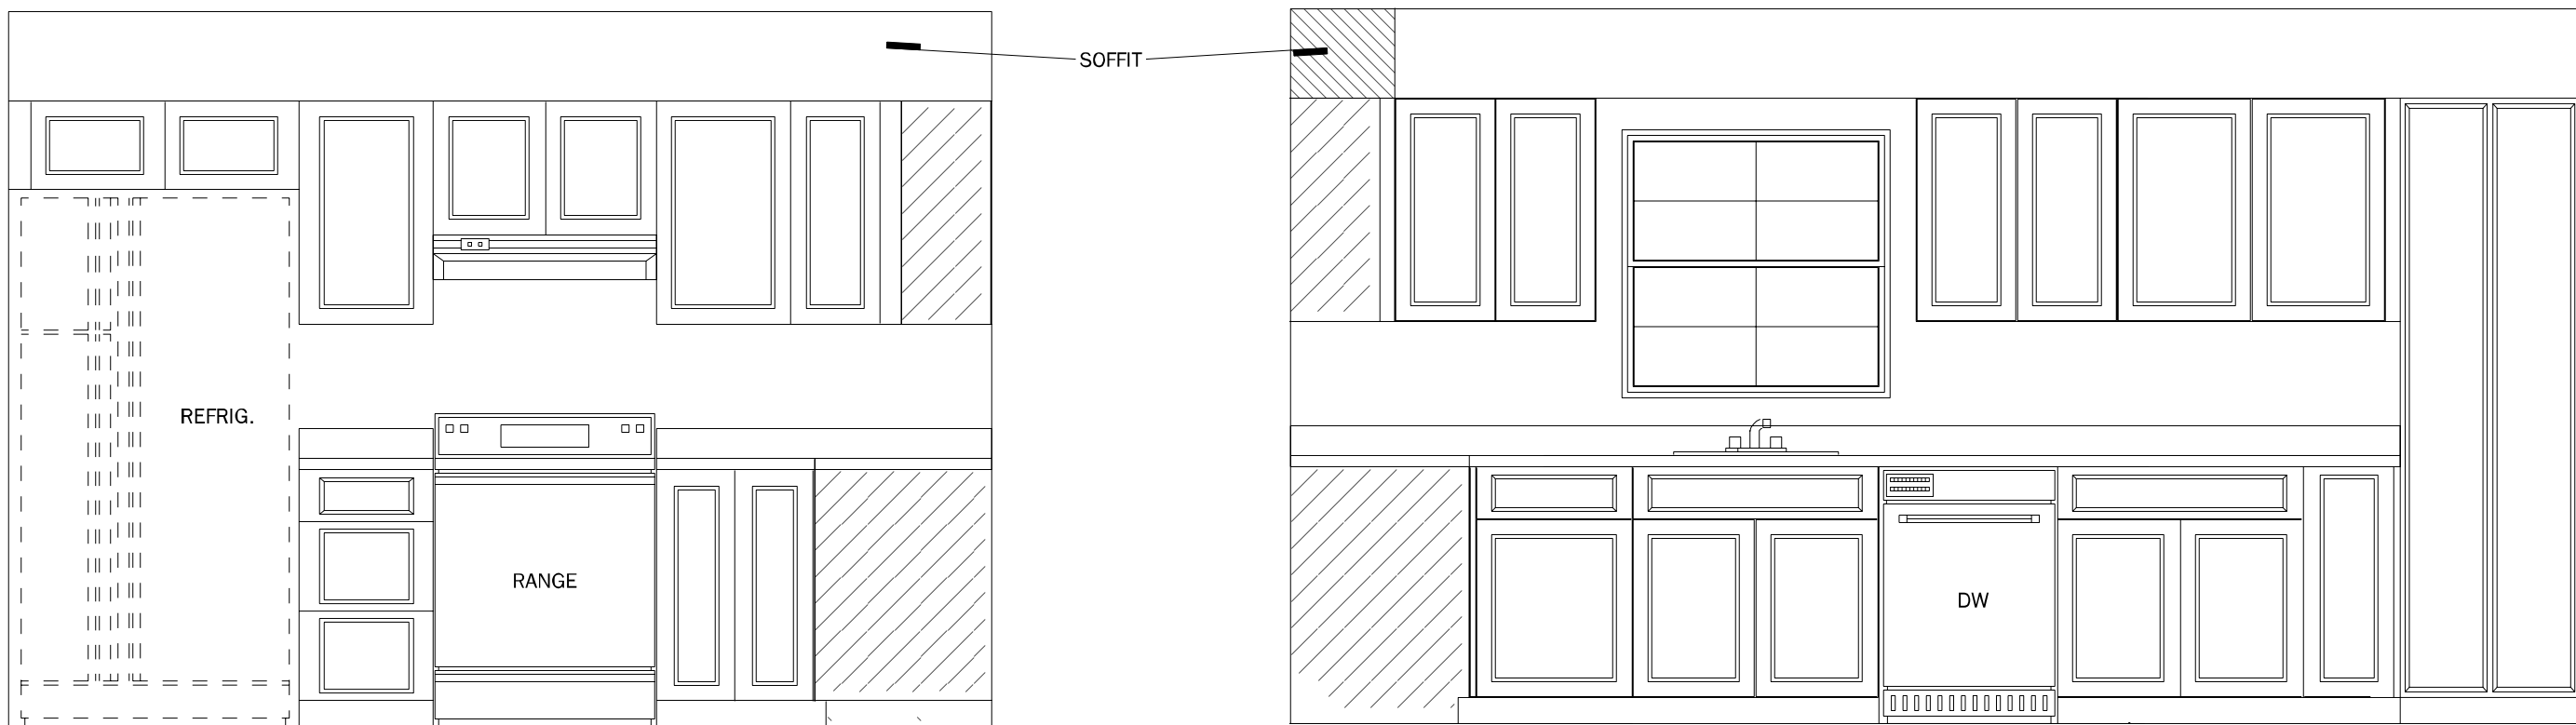


A
KITCHEN

B
KITCHEN

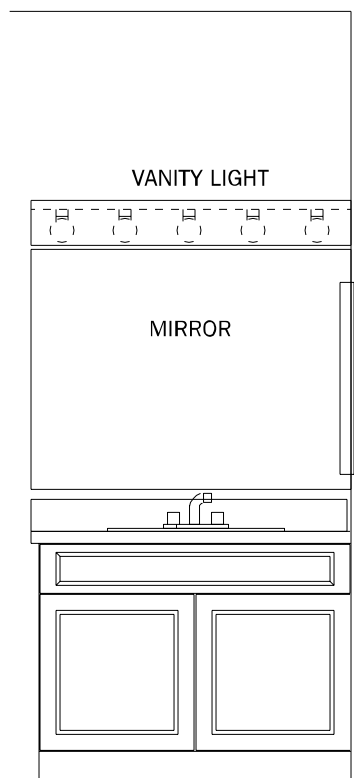

C
BATHROOM 2

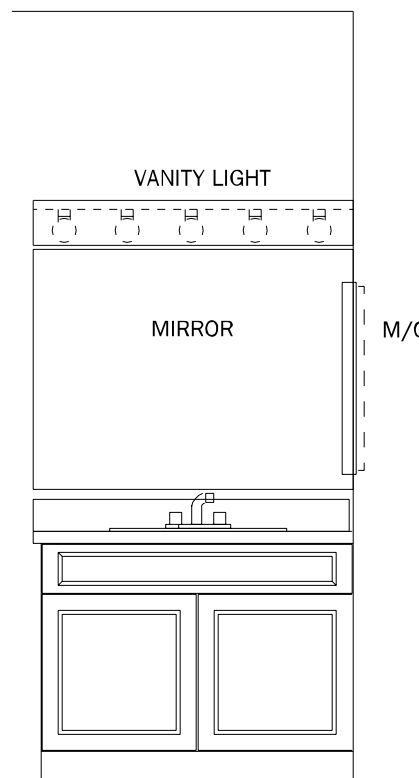

D
BATHROOM 1


INTERIOR ELEVATIONS

SCALE: 1/2" = 1'-0"

LOAD CALCULATIONS	
COOLING GREATER THAN HEATING	
GENERAL LIGHTING & RECEPTACLES	
3 WATTS PER SQUARE FOOT OF LIVING	
S.F. LIVING	1292 X3
	3876
APPLIANCE CIRCUITS	
1 RANGE	8500
0 OVEN	0
0 PEP TANK	0
1 MICRO / HOOD	1000
1 WATER HEATER	4500
0 WHIRL POOL	0
1 WASHER	1500
1 DRYER	5000
1 DISHWASHER	1500
0 WELL PUMP	0
0 IRRIGATION PUMP	0
1 DISPOSAL	600
SMALL APPLIANCE CIRCUITS	4500
2 BATH FANS (100 WATTS / EACH)	200
GENERAL LIGHT'G & RECEPT. + APP. CIR.	31176
SUBTRACT 100% OF FIRST 10,000	-10000
	A 21176
HVAC CIRCUITS	
1 A/C (AIR HANDLER & COMP.)	10000
1 A/C (AUXILIARY HEAT STRIP)	10000
	B 20000
CIRCUIT CALCULATIONS	
FIRST 10,000 AMPS @ 100%	10000
+ 40% OF "A" = (.40 X A)	= 8470.4
+ 100% OF "B"	= 20000
TOTAL WATTAGE	= 38470.4
WATTS DIVIDED BY 240 = AMPS	
CALCULATED SERVICE AMPS	= 160.2933
MIN. PANEL BOX SIZE TO BE 200 AMP	
Licensed Electrician to verify all loads and modify as needed	

ELECTRICAL PLAN

SCALE: 1/4" = 1'-0"

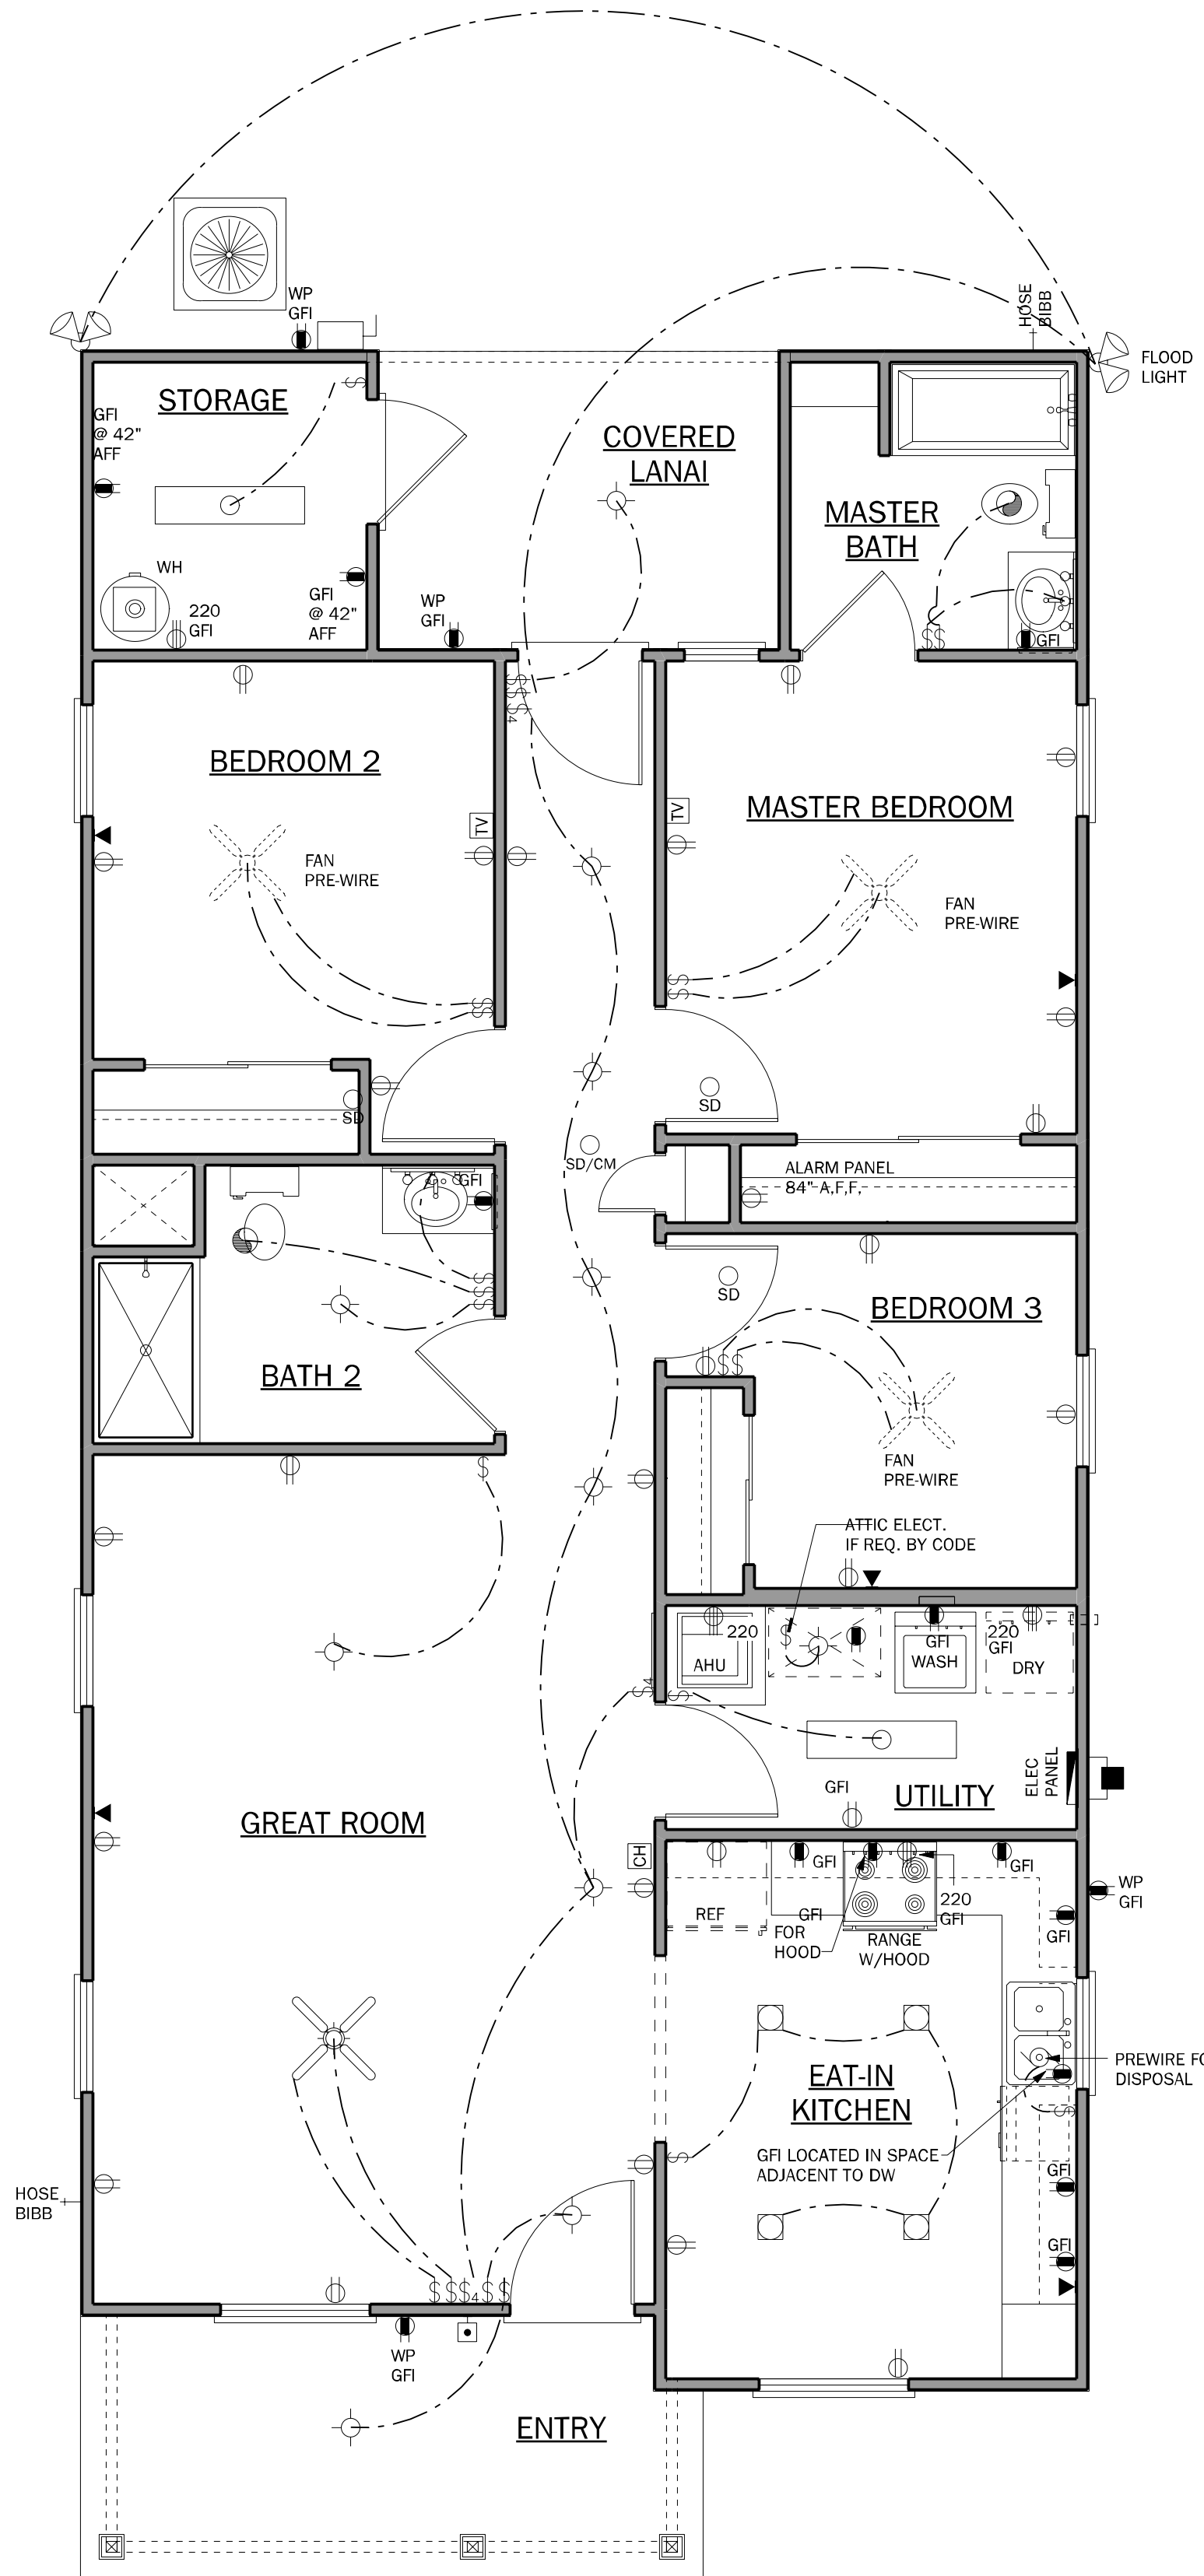

ELECTRICAL NOTES:

UNLESS OTHERWISE NOTED.

1. ELECTRICAL OUTLET HEIGHTS AS MEASURED FROM FINISHED FLOOR TO CENTER LINE OF THE BOX TO BE: 16" AFF (GENERAL), IN A FLOOD ZONE, ALL ELECTRICAL EQUIPMENT TO BE AT OR ABOVE DFE.
2. ALL TRIM PLATES AND DEVICES TO BE GANGED, WHERE POSSIBLE.
3. ELECTRICAL SWITCHES TO BE AT 42" CENTERLINE ABOVE FINISHED FLOOR.
4. ELECTRICAL PLAN IS INTENDED FOR BID PURPOSES ONLY. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (NEC), LATEST EDITION, BY A LICENSED ELECTRICAL CONTRACTOR WHO SHALL BE RESPONSIBLE FOR THE INSTALLATION & SIZING OF ALL ELECTRICAL WIRING & ACCESSORIES.
5. SMOKE ALARMS SHALL COMPLY WITH NFPA 72 AND SECTION R314 AND SHALL BE LISTED IN ACCORDANCE WITH UL 217 AND UL 2034.
6. PROVIDE AFCI'S (ARC-FAULT CIRCUIT INTERRUPTERS) COMBINATION TYPE INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUITS IN ALL DWELLING UNITS PER NFPA 70 (CURRENT EDITION) AND THE NEC AND AS DEFINED IN UL 1689.
7. PROVIDE TAMPER RESISTANT RECEPTACLES AS REQUIRED BY THE NFPA 70 (CURRENT EDITION).
8. CARBON MONOXIDE PROTECTION: CARBON MONOXIDE ALARMS OR DETECTORS SHALL BE INSTALLED IN ALL DWELLING UNITS IN ACCORDANCE WITH FBC R315 AND NFPA 70. SUCH DEVICES SHALL BE LISTED BY THE APPROPRIATE STANDARD, EITHER ANSI/UL 2034, STANDARD FOR SINGLE AND MULTIPLE STATION CO ALARMS OR UL 2075, GAS AND VAPOR DETECTOR SENSOR, ACCORDING TO THE INSTALLATION.
9. R315.1-2 COMBINATION ALARMS: COMBINATION SMOKE/CARBON MONOXIDE ALARMS SHALL BE LISTED AND LABELED BY A NATIONALLY RECOGNIZED TESTING LABORATORY.
10. KEEP ALL SMOKE DETECTORS MINIMUM OF 36" FROM BATHROOM DOORS.
11. IN NEW CONSTRUCTION, SMOKE DETECTORS SHALL BE HARDED INTO AN A/C ELECTRICAL POWER SOURCE AND SHALL BE EQUIPPED WITH A MONITORED BATTERY BACKUP.
12. BATHROOM EXHAUST FANS MUST VENT TO THE EXTERIOR OF THE BUILDING, VENTILATION TO ATTIC SPACE AND SOFFITS IS NOT ACCEPTABLE.
13. CHAPTER 45 PRIVATE SWIMMING POOLS — OUTDOOR SWIMMING POOLS SHALL BE PROVIDED WITH A BARRIER COMPLYING WITH R4501.17.1.1 THROUGH R4501.17.1.1.4.
14. ADD GFCI PROTECTION TO RECEPTACLES IN LAUNDRY ROOMS AND UTILITY ROOMS OF DWELLINGS WHERE INSTALLED WITHIN 6' OF THE OUTSIDE EDGE OF A SINK. THIS WOULD INCLUDE THE RECEPTACLE INSTALLED FOR A WASHING MACHINE. RECEPTACLE OUTLETS SHALL NOT BE REQUIRED ON A WALL DIRECTLY BEHIND A RANGE OR SINK TO FULFILL THE REQUIREMENT OF AN OUTLET EVERY 24". THE WIDTH OF THE SINK OR RANGE IS NOT TO BE INCLUDED IN THE SPACING OF THE OUTLETS UNLESS THE DISTANCE FROM THE SINK OR RANGE IS GREATER THAN 12" FOR STRAIGHT COUNTER TOPS AND 18" FOR SINKS AND RANGES INSTALLED IN CORNER COUNTERS.
15. WHERE MORE THAN ONE SMOKE ALARM IS REQUIRED TO BE INSTALLED WITHIN AN INDIVIDUAL DWELLING UNIT IN ACCORDANCE WITH SECTION R314.2, THE ALARM DEVICES SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTIVATION OF ONE ALARM WILL ACTIVATE ALL OF THE ALARMS IN THE INDIVIDUAL DWELLING UNIT. PHYSICAL INTERCONNECTION OF SMOKE ALARMS SHALL NOT BE REQUIRED WHERE LISTED WIRELESS ALARMS ARE INSTALLED AND ALL ALARMS SOUND UPON ACTIVATION OF ONE ALARM.
16. FOR ONE- AND TWO-FAMILY DWELLING UNITS, ALL SERVICE CONDUCTORS SHALL TERMINATE IN DISCONNECTING MEANS HAVING A SHORT-CIRCUIT CURRENT RATING EQUAL TO OR GREATER THAN THE AVAILABLE FAULT CURRENT. INSTALLED IN A READILY ACCESSIBLE OUTDOOR LOCATION. EACH DISCONNECT SHALL BE ONE OF THE FOLLOWING:
 - (1) SERVICE DISCONNECTS MARKED AS FOLLOWS:
 - EMERGENCY DISCONNECT,
 - SERVICE DISCONNECT
 - (2) METER DISCONNECTS INSTALLED PER 230.82(3) AND MARKED AS FOLLOWS:
 - DISCONNECT THAT ARE SUITABLE FOR USE AS SERVICE EQUIPMENT AND MARKED AS FOLLOWS:
 - EMERGENCY DISCONNECT,
 - METER DISCONNECT
 - NOT SERVICE EQUIPMENT
 - (3) OTHER LISTED DISCONNECT SWITCHES OR CIRCUIT BREAKERS ON THE SUPPLY SIDE OF EACH SERVICE DISCONNECT THAT ARE SUITABLE FOR USE AS SERVICE EQUIPMENT AND MARKED AS FOLLOWS:
 - EMERGENCY DISCONNECT,
 - NOT SERVICE EQUIPMENT
 - MARKINGS SHALL COMPLY WITH 110.21(B).
 - 17. ALL PERMANENTLY INSTALLED LUMINARIES, EXCLUDING THOSE IN KITCHEN APPLIANCES, SHALL HAVE AN EFFICACY OF AT LEAST 45 LUMENS-PER-WATT OR SHALL UTILIZE LAMPS WITH AN EFFICACY OF NOT LESS THAN 65 LUMENS-PER-WATT.
 - 18. ENERGY COMPLIANCE PATH IS PERFORMANCE BASED PATH.

ELECTRICAL LEGEND

POWER SYMBOLS


110-115 RECEPTACLE	VP	VAPOR PROOF
GROUND FAULT INTERRUPT RECEPTACLE	GFI	GROUND FAULT INTERRUPT
SWITCHED RECEPTACLE	AFI	ARC FAULT INTERRUPT
QUAD RECEPTACLE	G.D.O.	GARAGE DOOR OPENER
SOFFIT RECEPTACLE	PS	PULL STRING
FLOOR RECEPTACLE	⚡	MOTOR
220 RECEPTACLE	⚡	BATH FAN
SPECIAL PURPOSE RECEPTACLE	⚡	BATH FAN AND LIGHT COMBINATION
WP	⚡	SINGLE POLE SWITCH
SMOKE DETECTOR	⚡	THREE WAY SWITCH
CARBON MONOXIDE DETECTOR	⚡	FOUR WAY SWITCH
COMBINATION SMOKE AND CARBON MONOXIDE DETECTOR	⚡	DIMMER SWITCH
CEILING FAN PREWIRE	⚡	DISCONNECT SWITCH
INSTALLATION PER CONTRACT, LED LIGHT FLUSH MOUNT (VERIFY W/ BUILDER)	⚡	JUNCTION BOX
CEILING FAN WITH LIGHT KIT	⚡	ELECTRIC PANEL
INSTALLATION PER CONTRACT	⚡	METER BASE

LIGHTING SYMBOLS

CEILING MOUNTED LIGHT	
WALL MOUNTED LIGHT	FLOUR, SINGLE BULB
WALL WASH FIXTURE	FLOUR, DOUBLE BULB
RECESSED LIGHT	FLOUR, WRAP
BATH FAN WITH LIGHT	EMERGENCY LIGHT
DOUBLE FLOOD LIGHT	

LOW VOLTAGE SYMBOLS

SPEAKER	PUSH BUTTON
TV OUTLET	DATA OUTLET
TELEPHONE	INTERCOM SYSTEM
DOOR CHIME	THERMOSTAT

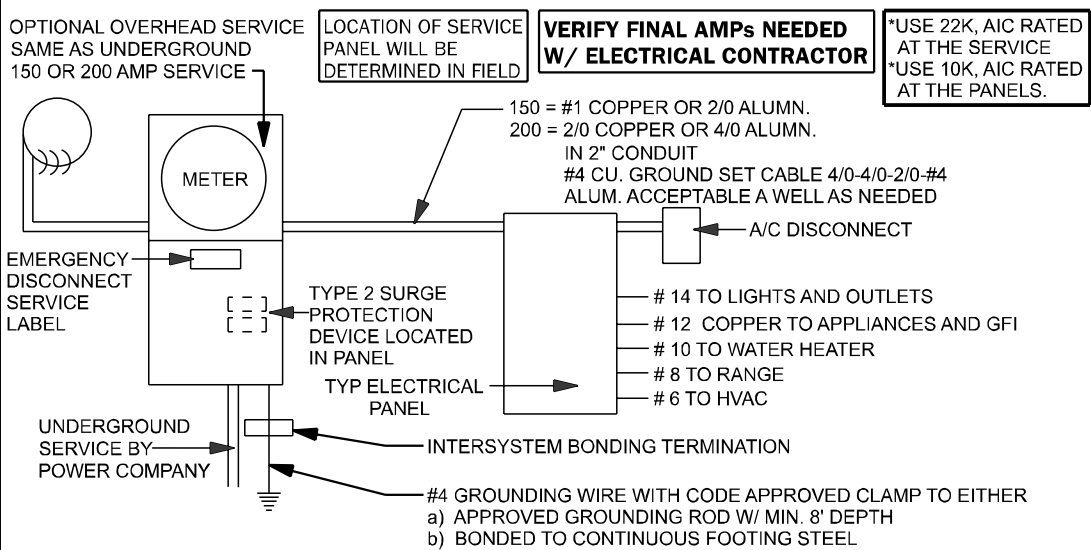

ELECTRICAL RISER

N.T.S.

NOTE: ELECTRICAL MATERIAL AND INSTALLATIONS SHALL COMPLY WITH APPLICABLE PROVISIONS AS STATED ON STRUCTURAL NOTES SHEET LOCAL CODES AND THE LOCAL POWER CO.



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
SCOTT A. BROWN, PE - FL #56126
CARL LEWKOWSKI, PE - FL #78750

100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/19/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Edition. Engineer's signature and seal is only for the structural engineering portion of the drawing pages bearing engineer's signature and seal.


This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright or intellectual property are reserved. The reproductions, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and International law.



Builder:

LOT:	UNIT:
Community:	BLK:
Plot Name:	Project Name:
The DROSTE	
Project Address:	Client No.:


Project No:
25-06831
Sheet No:
4
ELECTRICAL/INT. ELEV.

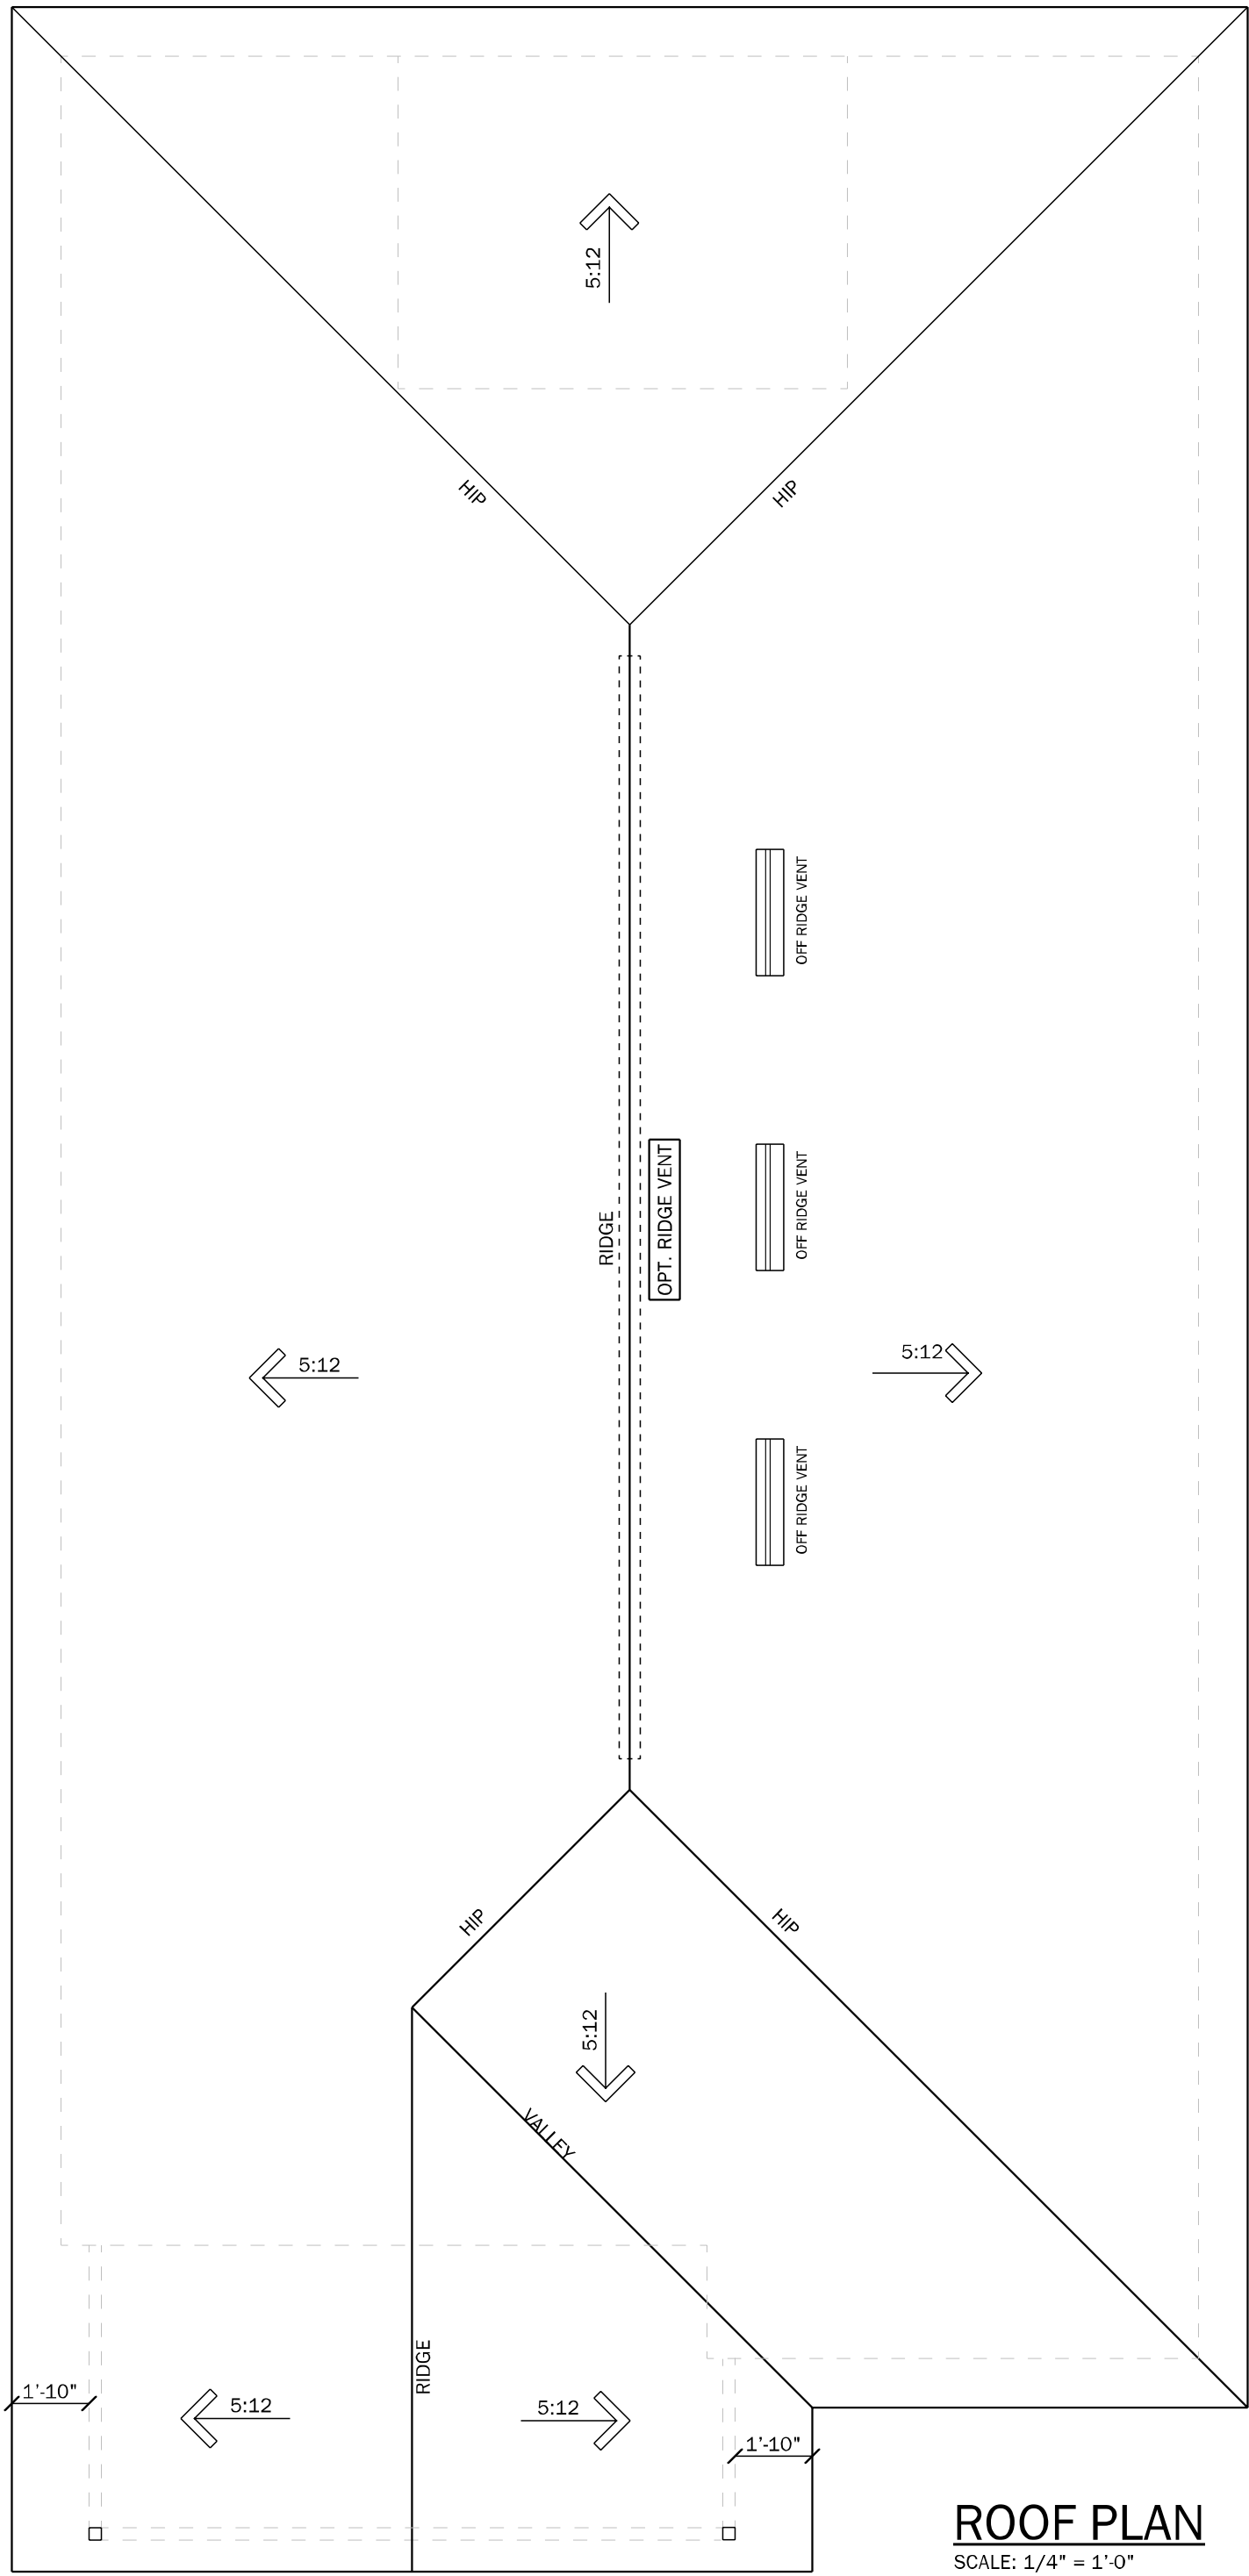


ROOF PLAN
SCALE: 1/4" = 1'-0"

ROOF CRITERIA

- 14" OVERHANG @ EAVES U.N.O.
- 9" OVERHANG @ GABLES U.N.O.
- PLUMB FASCIA
- ROOF PITCH PER ELEVATION
- SHINGLE LOADING

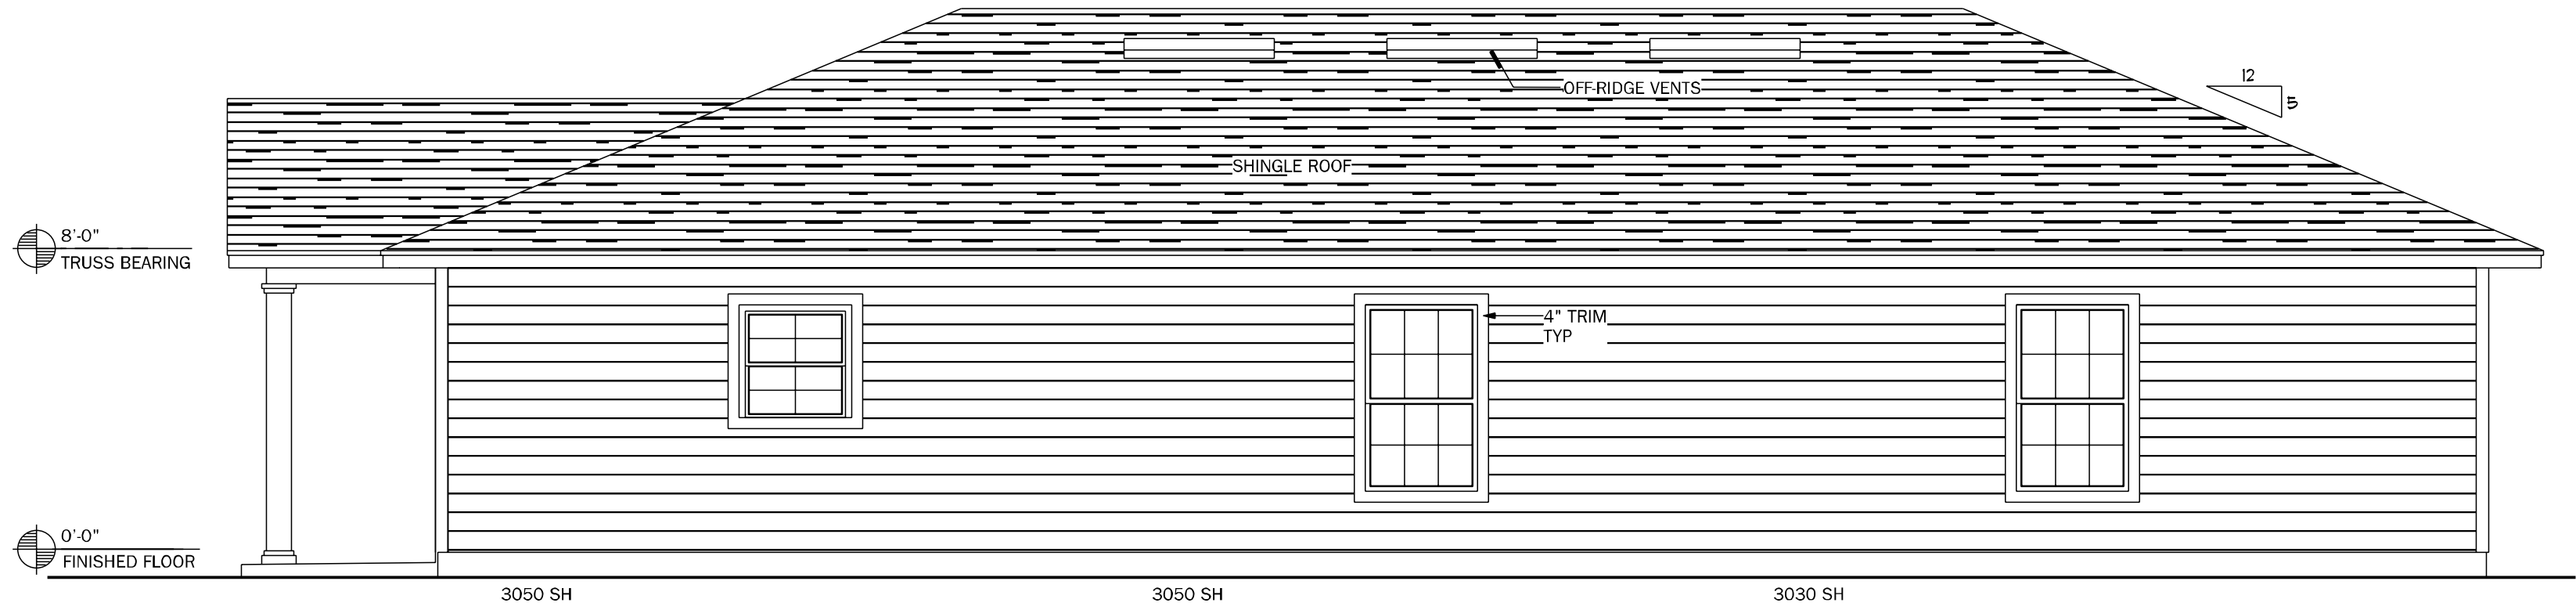


RIGHT SIDE ELEVATION
SCALE: 1/4" = 1'-0"

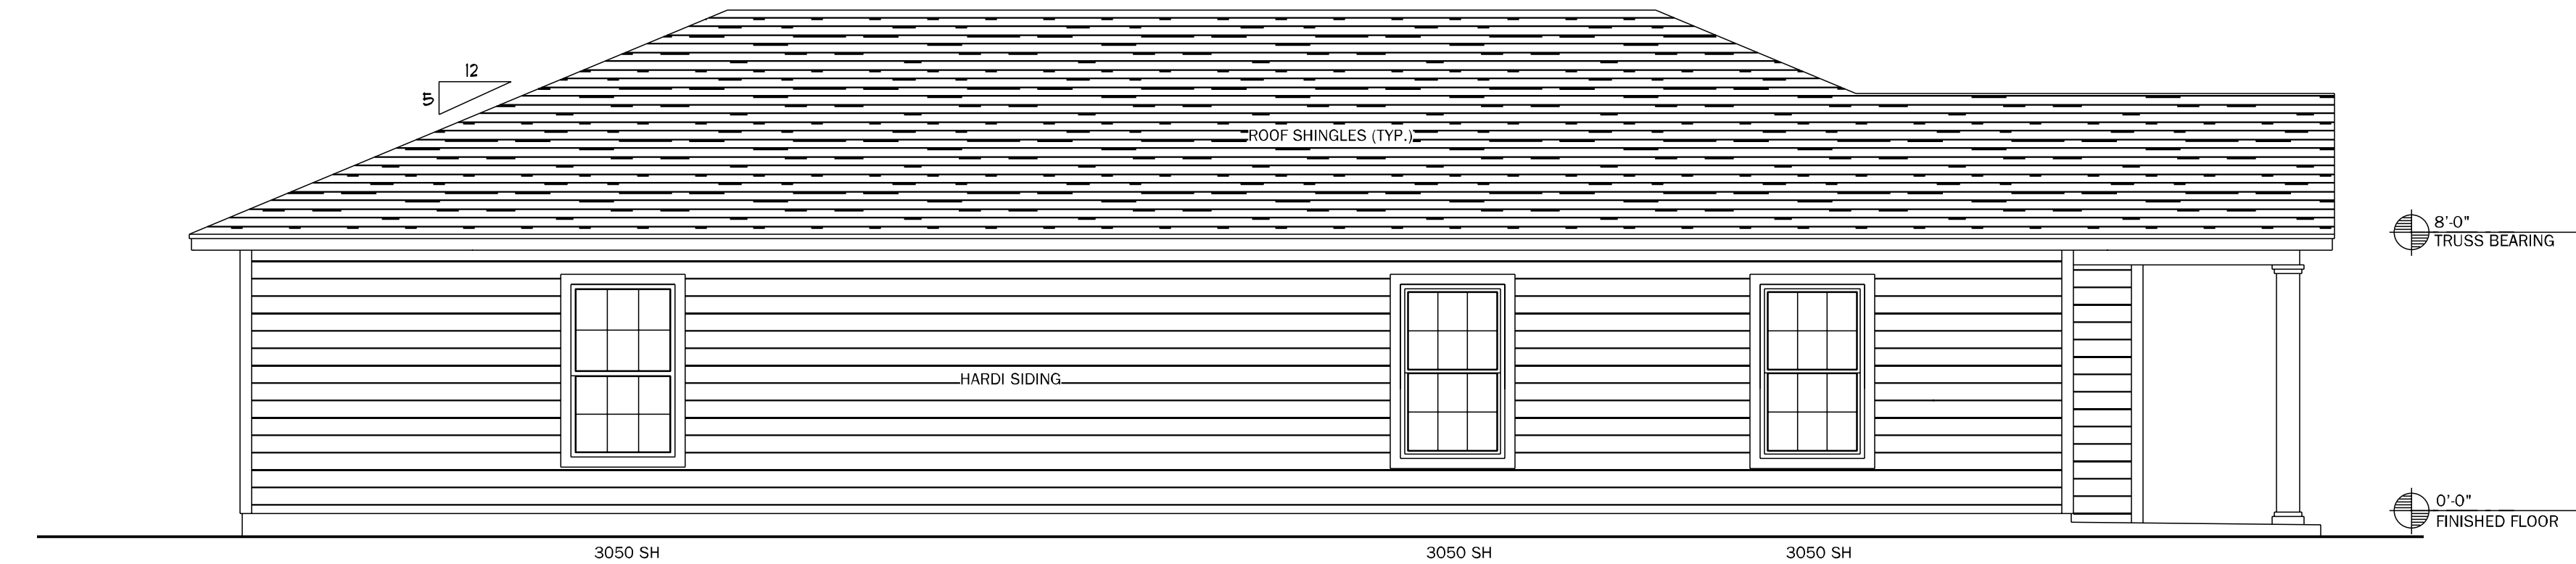

LEFT SIDE ELEVATION
SCALE: 1/4" = 1'-0"



REAR ELEVATION
SCALE: 1/4" = 1'-0"

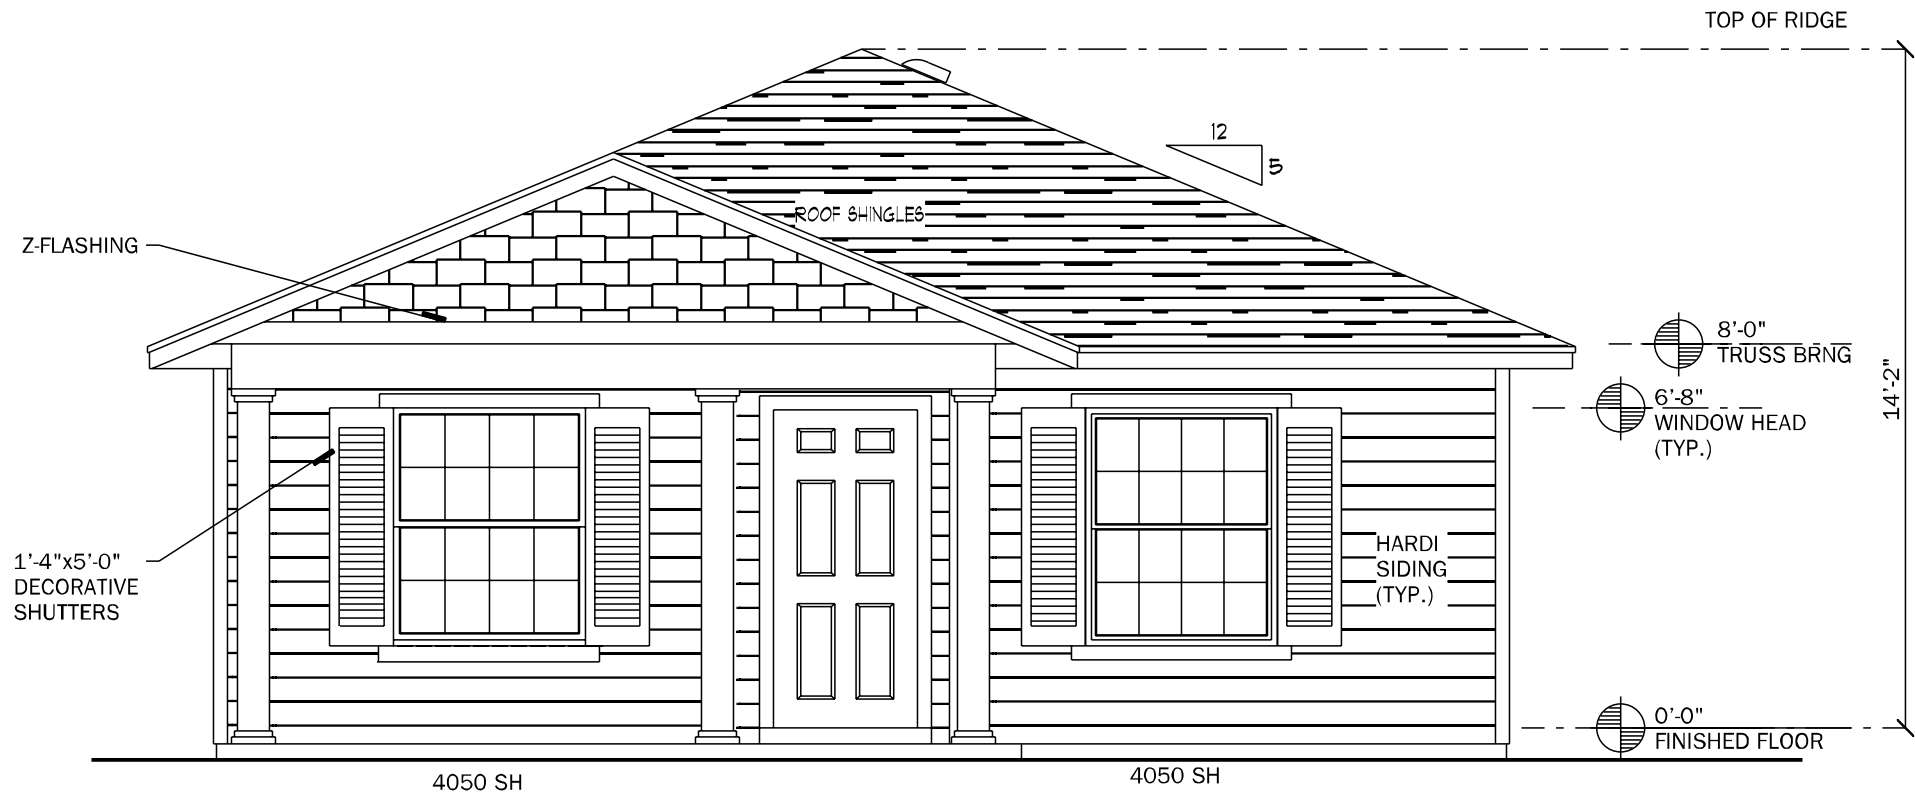

FRONT ELEVATION
SCALE: 1/4" = 1'-0"

VENTILATION CALCULATION

Calculations shown below are for both, off ridge and ridge vent systems. Only ONE system is required. See builder's specs for product used. Formula = SF / 300 / 2 * 144 = net sq. inches of venting needed. (Based on the 1/300 exception for the minimum vent area).	
S.F. of Area to be vented (SF)	1596
Total needed for exhaust for upper 1/3 Upper = 45% approx.	336 net sq inches
Total needed for intake (soffit area, lower) Lower = 55% approx.	411 net sq inches
Total needed combined to be no less than 40% and no more than 50%	747 upper 1/3= 45%
Soffit product provides	6.57 net sq in / sf
Overhang distance	1.00 ft
Net sq in per linear feet of soffit	6.57 sq in / lf
Linear Feet of soffit needed to meet required	60
Linear Feet of soffit provided by plan	154
Option one (Ridge vents)	
Ridge vent provides	18.00 net sq in / lf
L.F. of Ridge Vent needed	15
Option two (Off ridge vents)	
Off ridge vent provides	138.00 net sq in / sf
Number of Off Ridge Vents for upper 1/3	3



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750
100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/19/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code-Residential Sm edition. Engineer's signature and seal is only for the structural engineering portions of the drawing. Engineer's signature and seal is not valid for the building engineering portions of the drawing.

This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright or intellectual property are reserved. The reproduction, copying or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and international law.



Builder:

LOT:	BLK:	UNIT:
Community:		
Plan Name:	The DROSITE	
Project Address:		
Client No.:		


Project No.: 25-06831
Sheet No.:

Project No:
25-06831
Sheet No:

S-1


ROOF FRAMING PLAN

HEADER SUPPORT # OF JACKS & STUDS REQ'D AT OPENINGS				
OPENING SIZE	2x4 WALL JACKS (EA END)	2x6 WALL JACKS (EA END)	2x8 WALL JACKS (EA END)	2x10 WALL JACKS (EA END)
< 4'-0"	(1)	(2)	(1)	(2)
> 4'-0" BUT < 8'-0"	(2)	(3)	(2)	(2)
10'-0" - 16'-0"	(3)	(4)	(3)	(4)

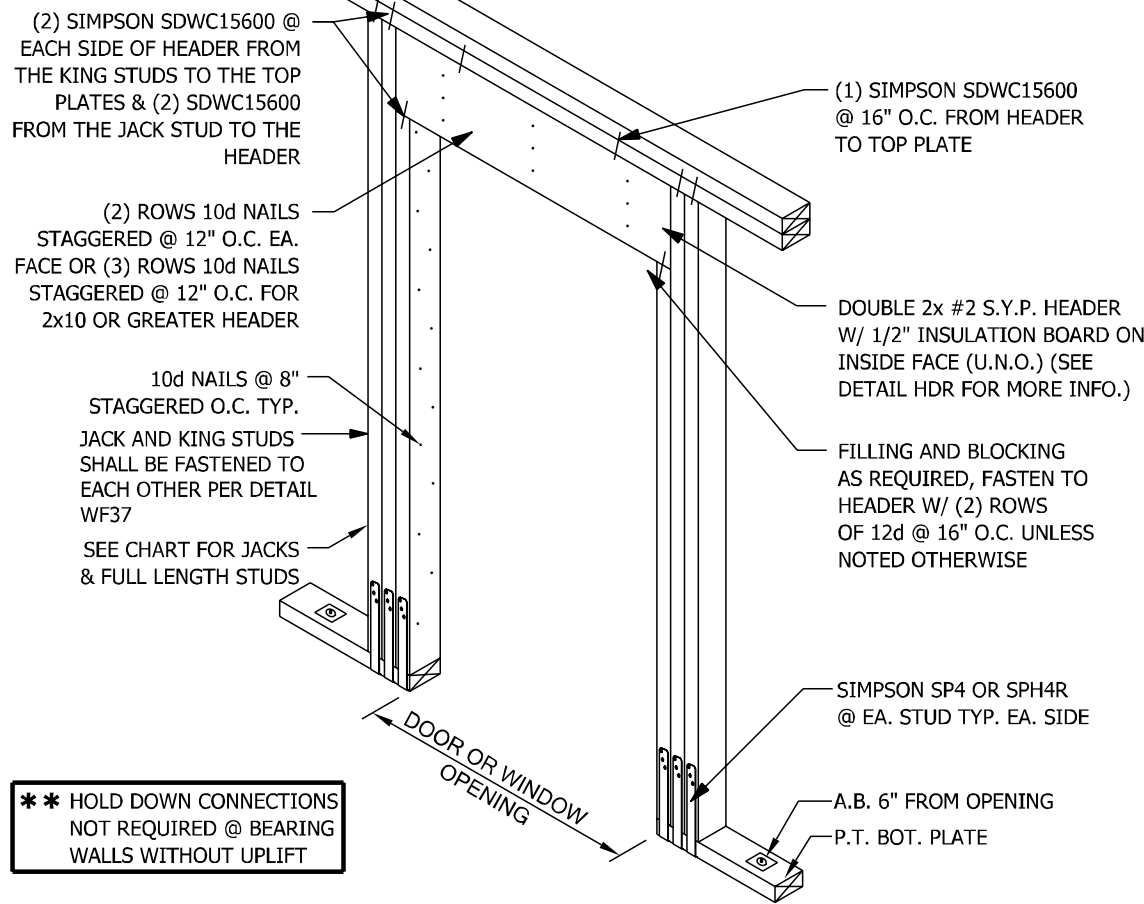


WF09 WALL HEADER DETAIL

N.T.S.

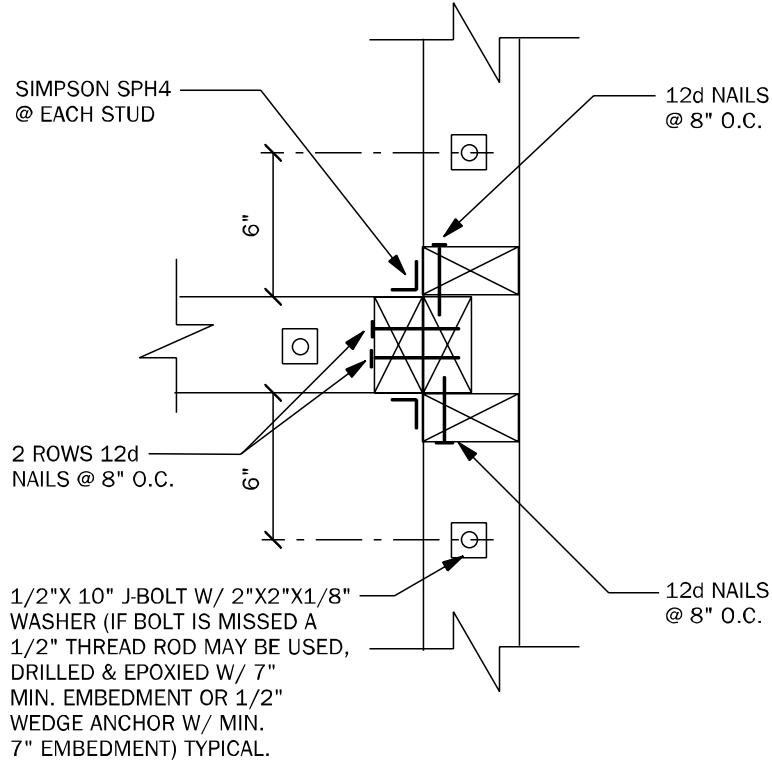


WC03 WALL TO WALL CONN. @ END OF SHEARWALL 1 1/2" = 1'-0"

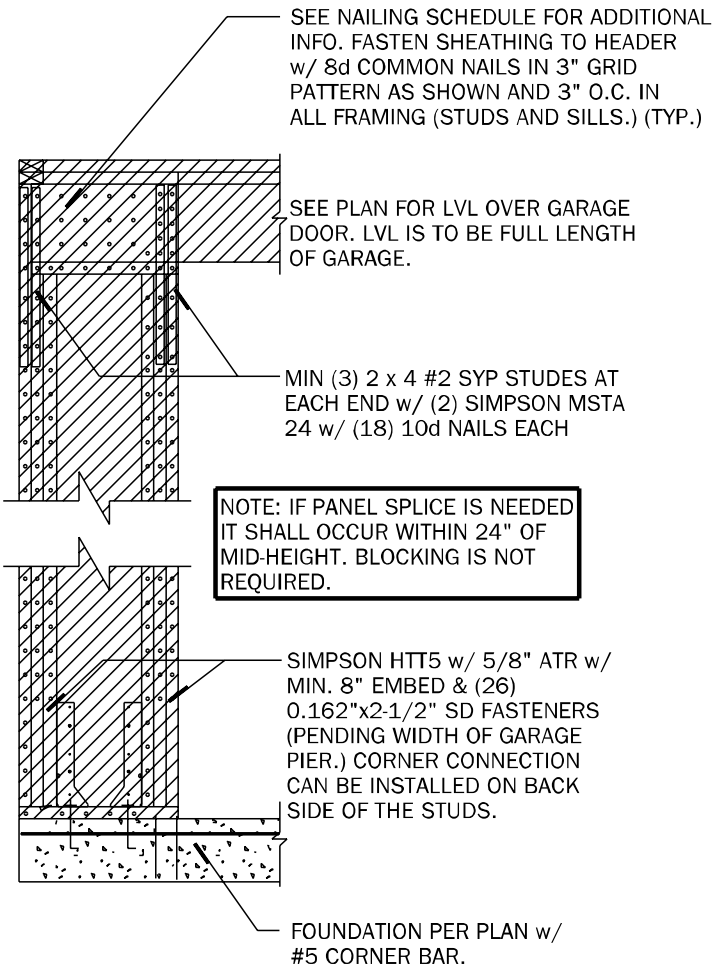


WC04 GARAGE HEADER ANCHOR

N.T.S.

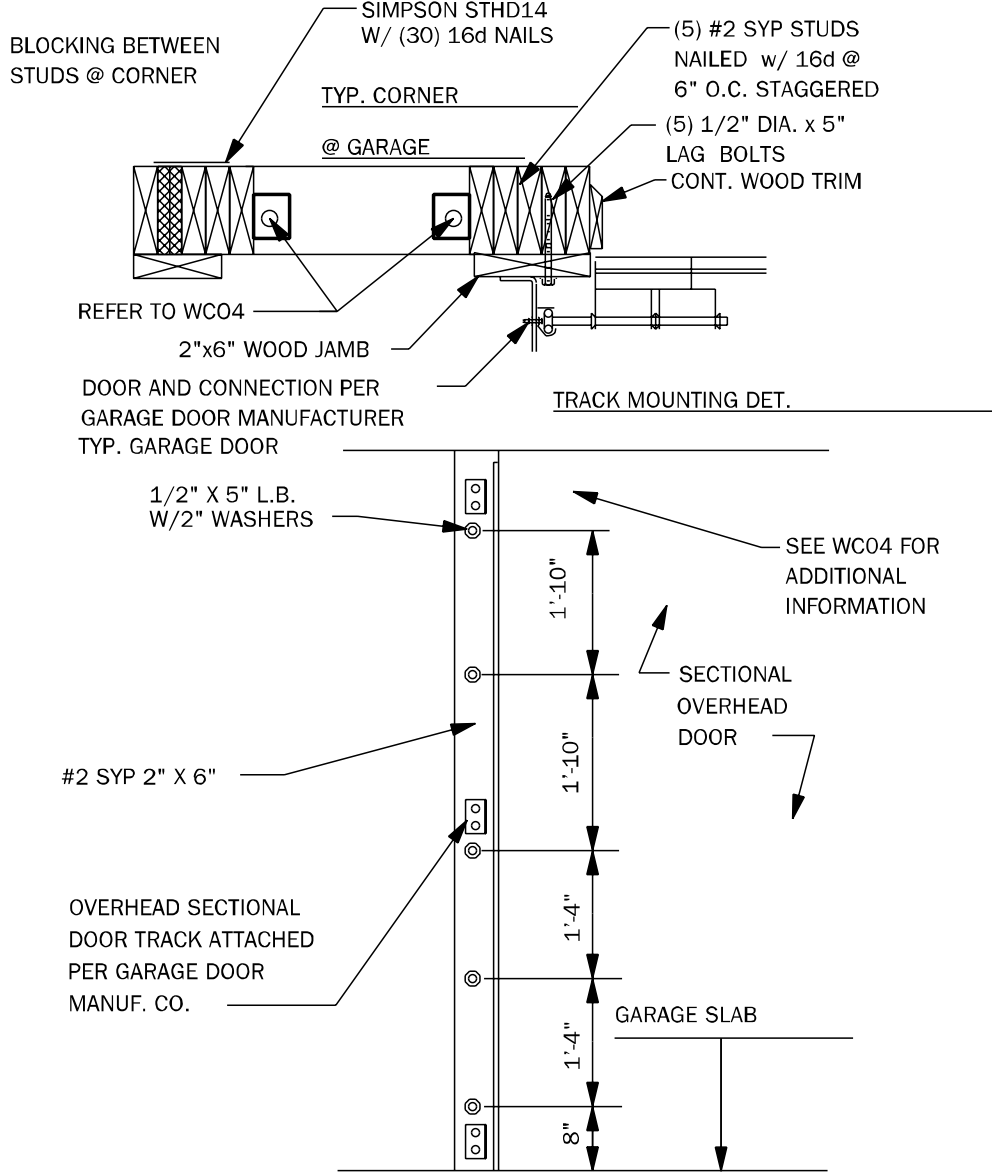


WC05 SECT. OVERHEAD GAR. DOOR INSTALL

N.T.S.

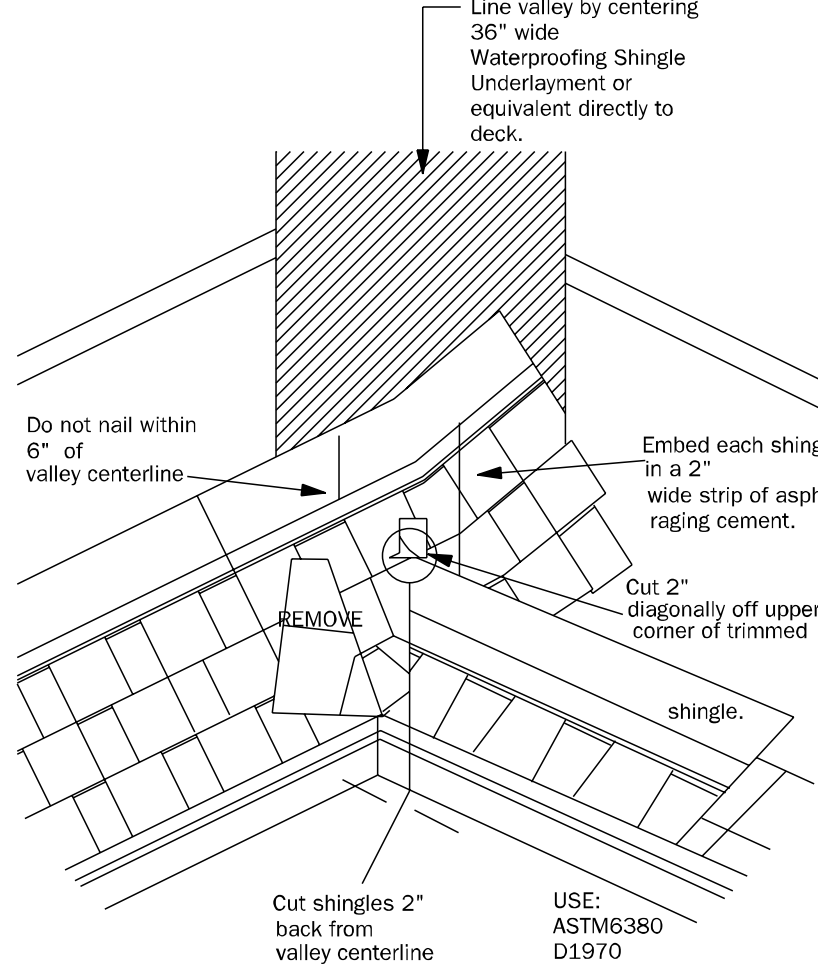


RD01 VALLEY FLASHING DETAIL

N.T.S.

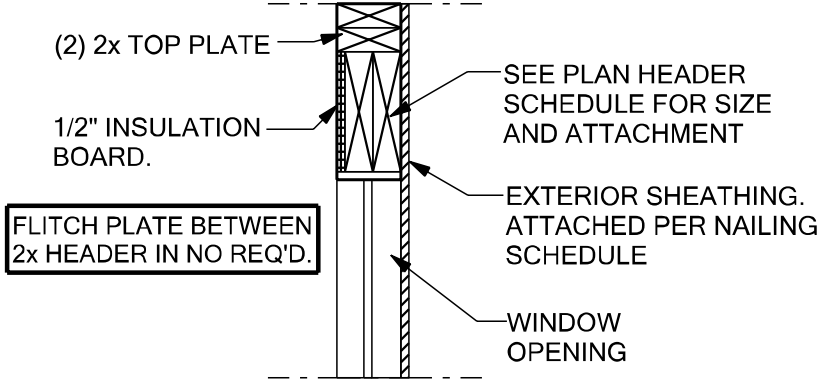


HDR ALT. INSULATION DETAIL

1" = 1'-0"

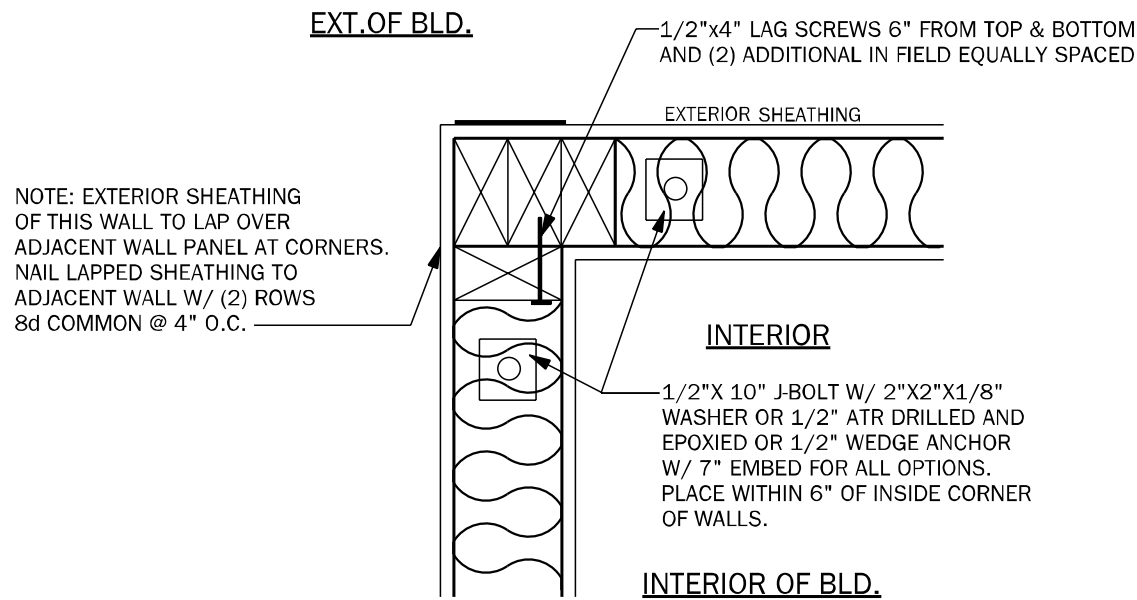

WC06 EXTERIOR FRAME CORNER w/ PANELS


3/4" = 1'-0"

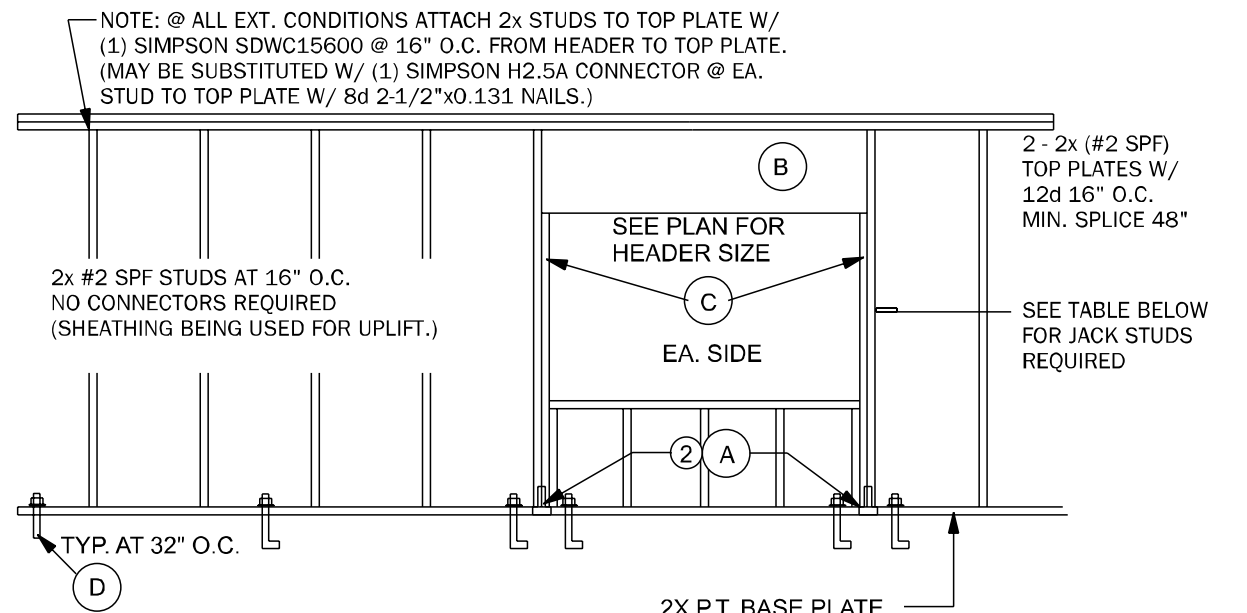

CONNECTOR LEGEND		WINDOW & DOOR JACK TABLE	
(A)	SIMPSON SPH4 W/ (12) 10d x 1-1/2"	PROVIDE JACKS @ EACH END AS FOLLOWS	
(B)	(1) SIMPSON SDWC15600 @ 16" O.C.	(2) WHEN OPN'GS ARE GREATER THEN 4'-0"	
(C)	(2) SIMPSON SDWC15600 @ EACH SIDE OF HEADER FROM KING STUDS TO TOP PLATE & (2) SDWC15600 FROM JACK STUD TO HEADER	(3) WHEN OPN'GS ARE GREATER THEN 10'-0" BUT LESS THAN 16'-0"	
(D)	1/2" X 10" J-BOLT W/ 2" X 2" X 1/8" WASHER @ 32" O.C. PLUS (2) WITHIN 6" EACH SIDE OF JACK STUDS @ HEADER	NOTE: FOR EXTERIOR OR SHEAR WALL SEE SHEET S1 FOR WALL & ROOF SHEATHING INSTALLATION & NAILING SCHEDULES	


WF66 TYPICAL BEARING WALL

N.T.S.

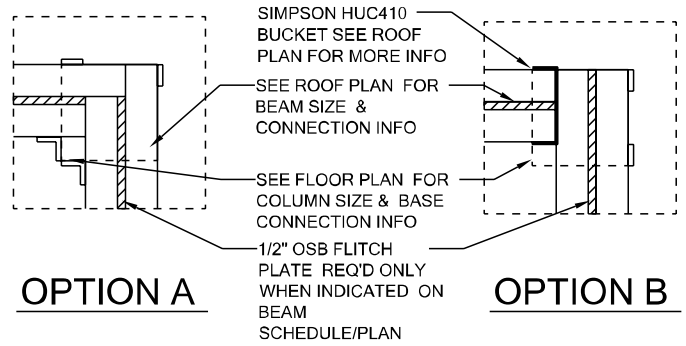


CD11 COMMON BM. TO POST ATTACHMENT

N.T.S.

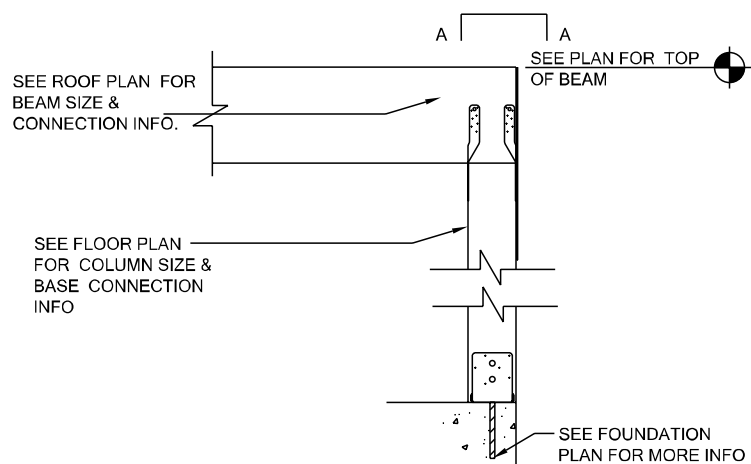


NOTE: @ ALL EXT. CONDITIONS ATTACH 2x STUDS TO TOP PLATE W/ (4) 16d TONAILS (2) ON EA. SIDE TYP. TOE NAILS MAY BE SUBSTITUTED W/ (1) SIMPSON H2.5A CONNECTOR @ EA. STUD TO TOP PLATE W/ 8d 2 1/2" x 0.131 NAILS

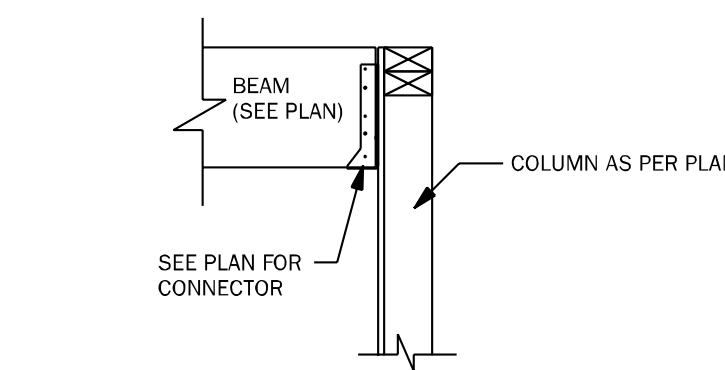


CD25 BEAM TO WALL CONNECTION

N.T.S.

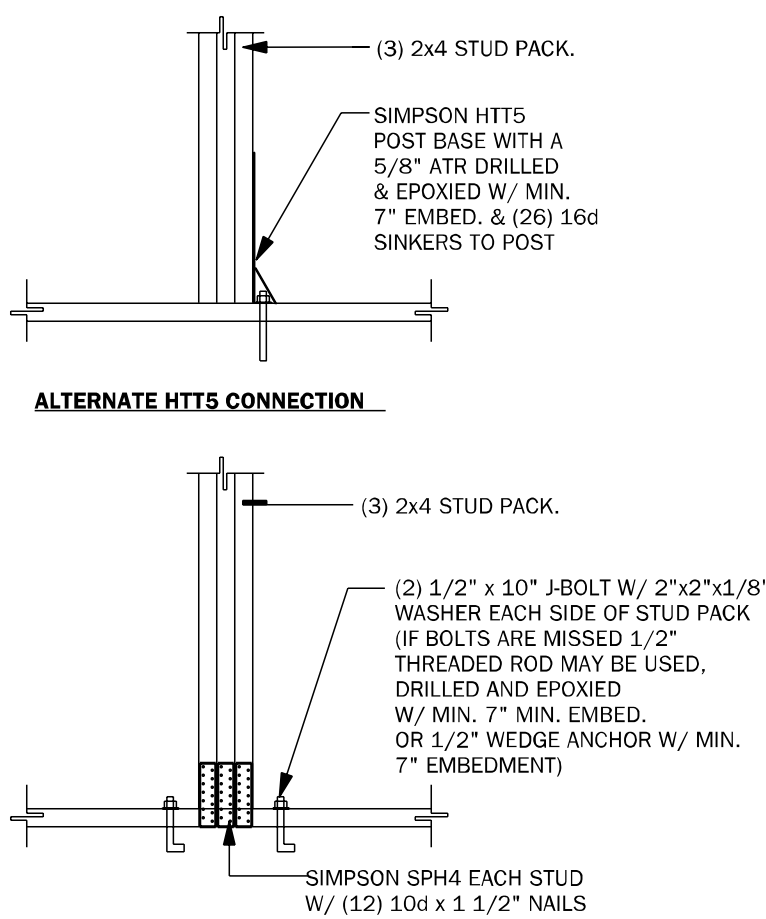

CD26 GIRDER BASE CONNECTION

1/2" = 1'-0"

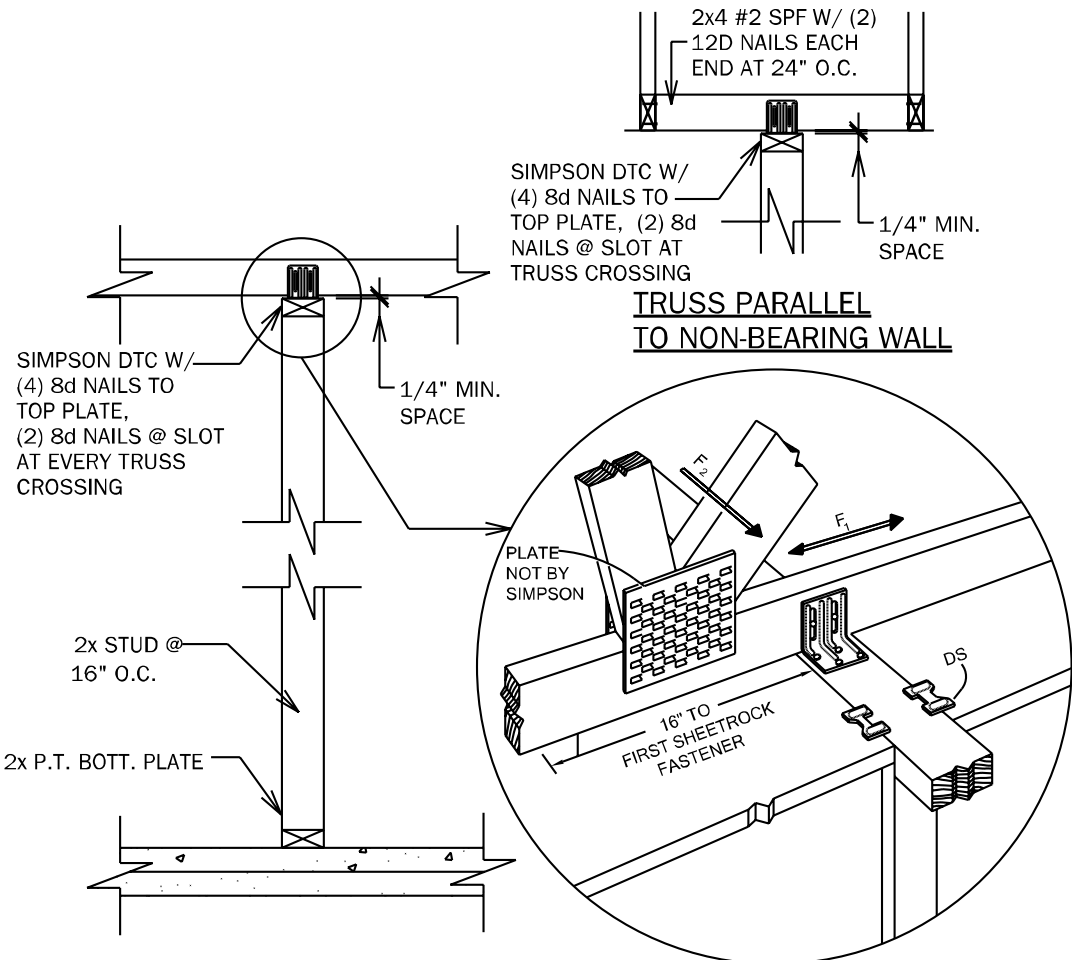

WF18 TYPICAL INTERIOR NON-BEARING WALL

3/4" = 1'-0"



TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750
100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/19/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Edition. Engineer's signature and seal is only for the structural engineering portion of the drawing pages bearing engineer's signature and seal.


This document and/or the design concepts expressed herein are the property of TSG Total Solutions Group, Inc. and all rights of ownership, including copyright or intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG Total Solutions Group, Inc. is strictly prohibited and protected by United States and International law.




4116 Silver Star Rd.
Orlando, FL 32808
Office: (407) 648-4367
habitat@osceola.org

COPIES:	UNIT:	BLK:	Community:	Plan Name:	Project Address:	Client No.:
				The DROSTE		


Project No: 25-06831
Sheet No: S-2
TYPICAL FRAMING DETAILS

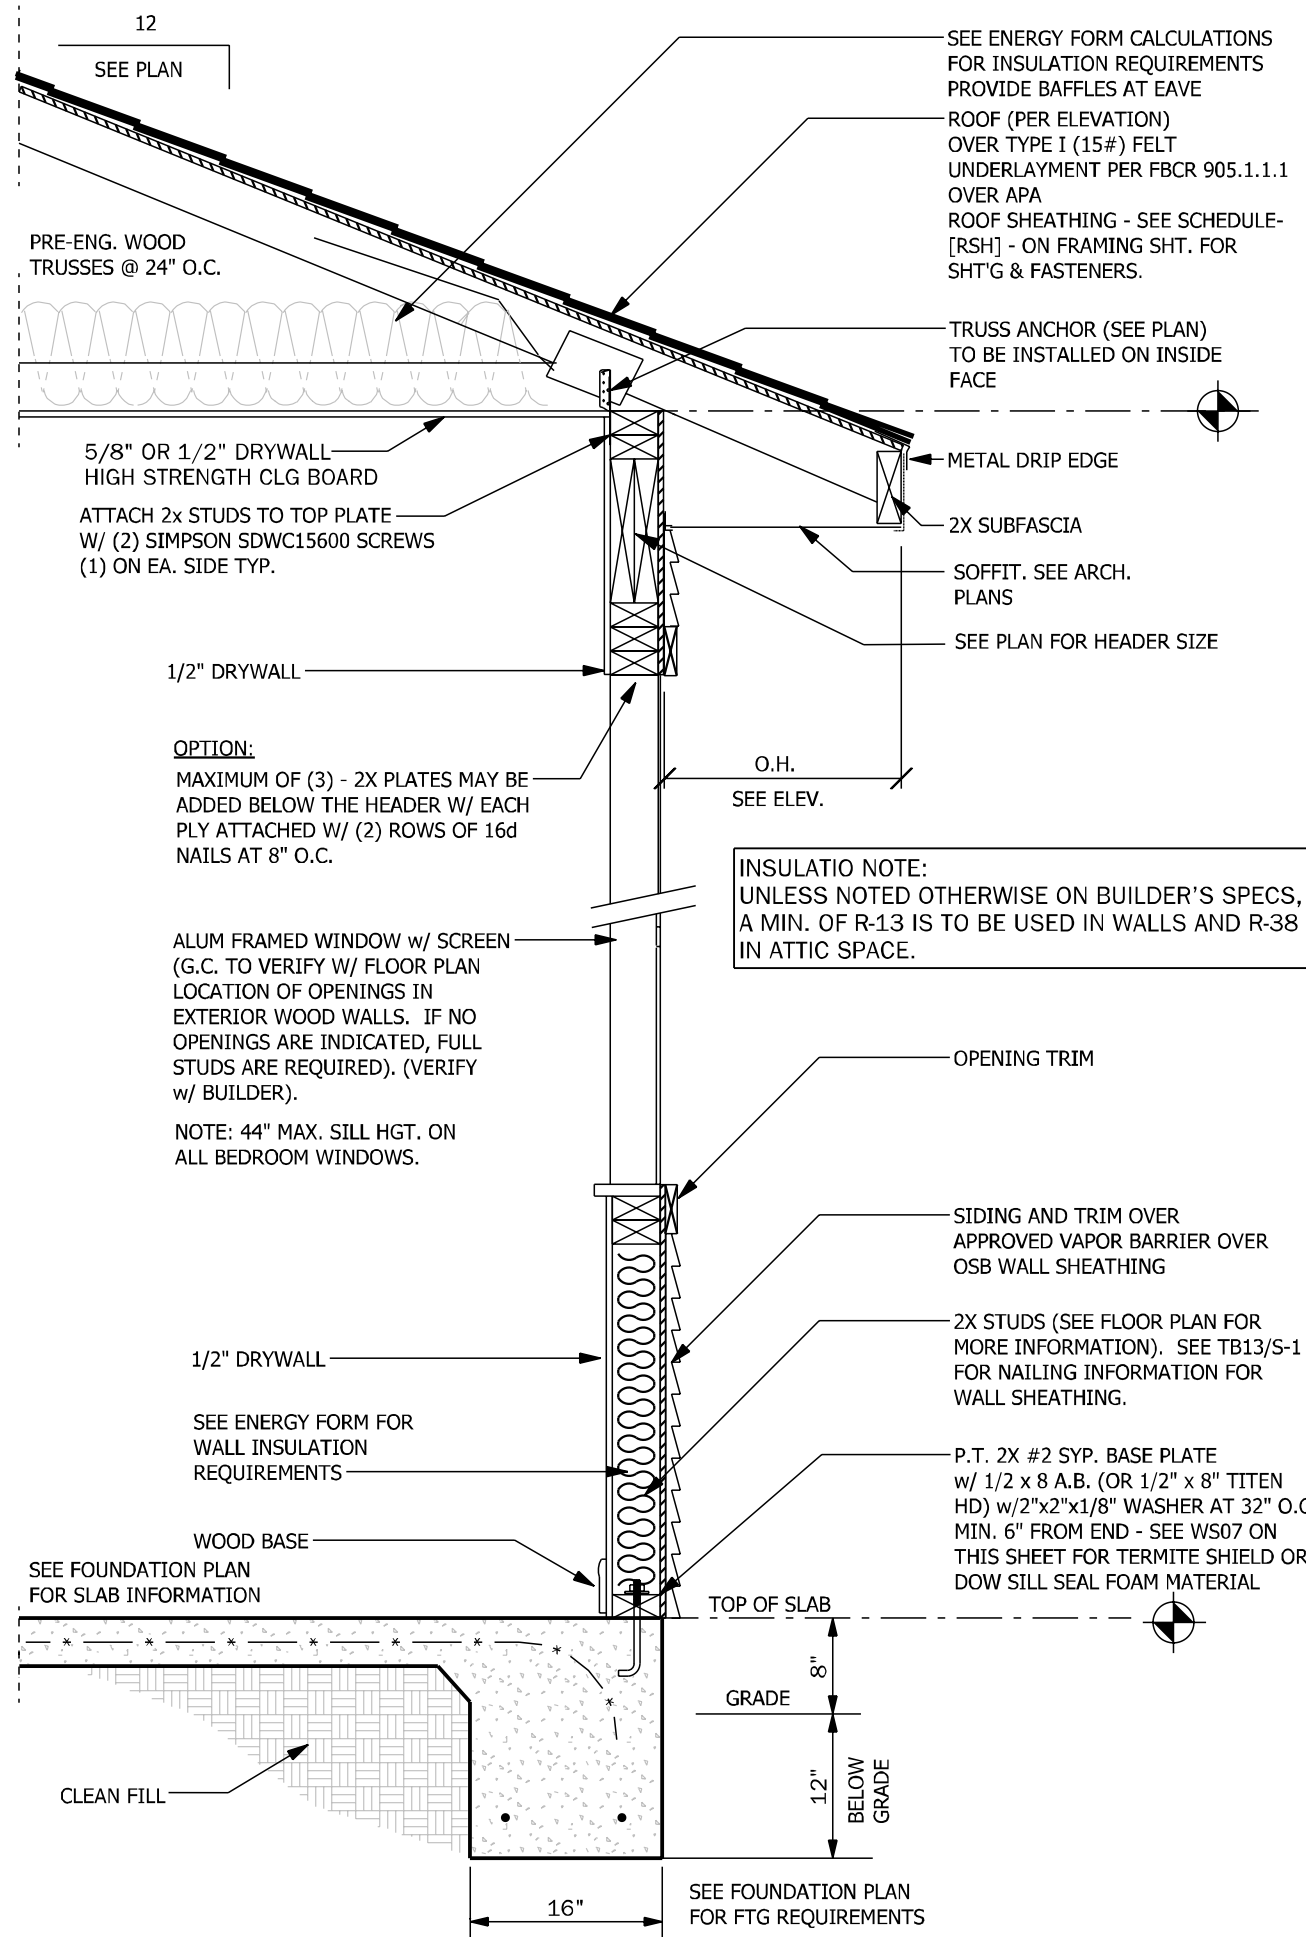


WS02 TYPICAL WALL SECTION EXTERIOR FRAME 3/4" = 1'-0"

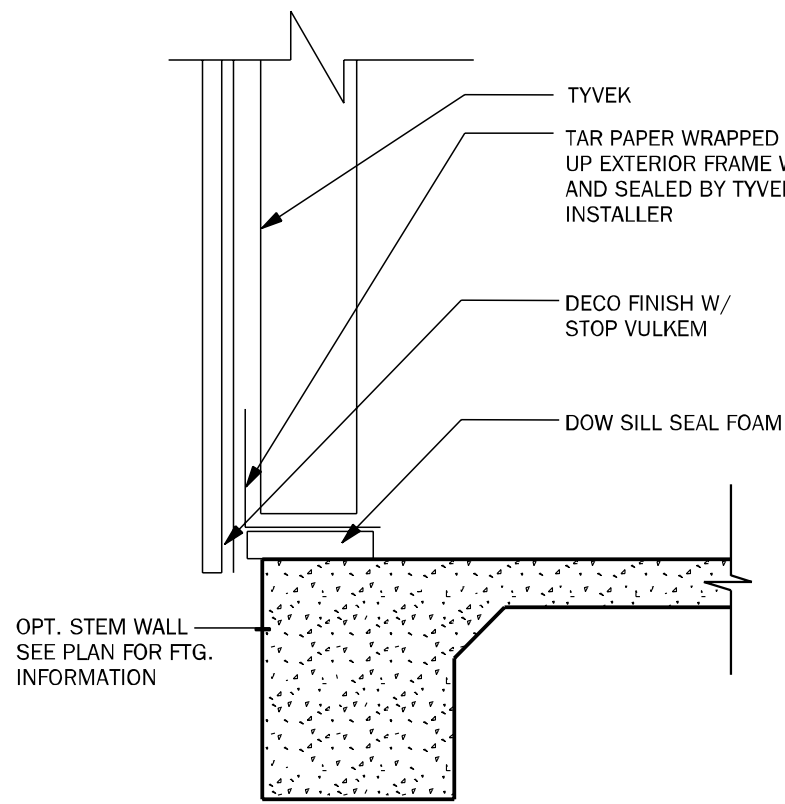


WS07 EXT. FRAME WALL TERMITE DETAIL 3/4" = 1'-0"

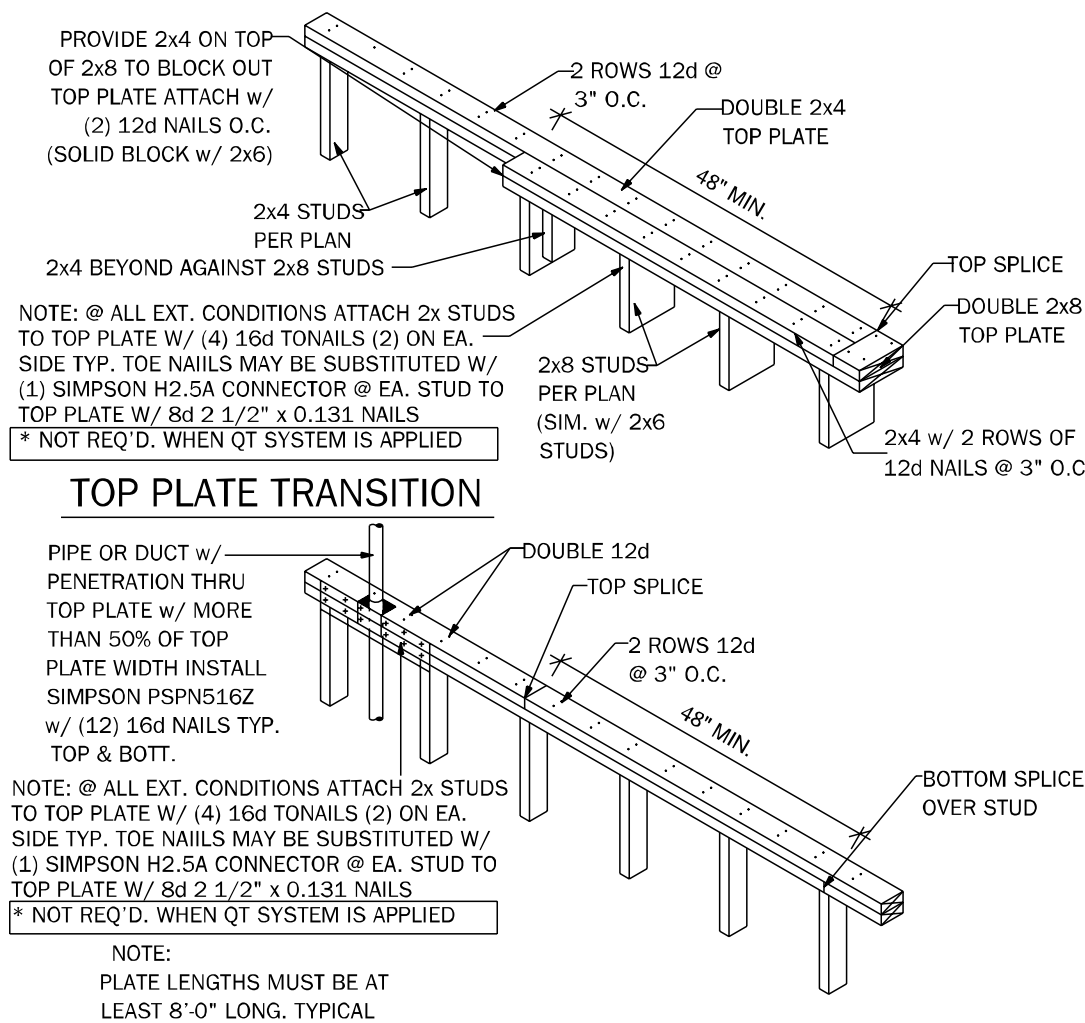


WF17 TOP PLATE SPLICE DETAIL 3/4" = 1'-0"

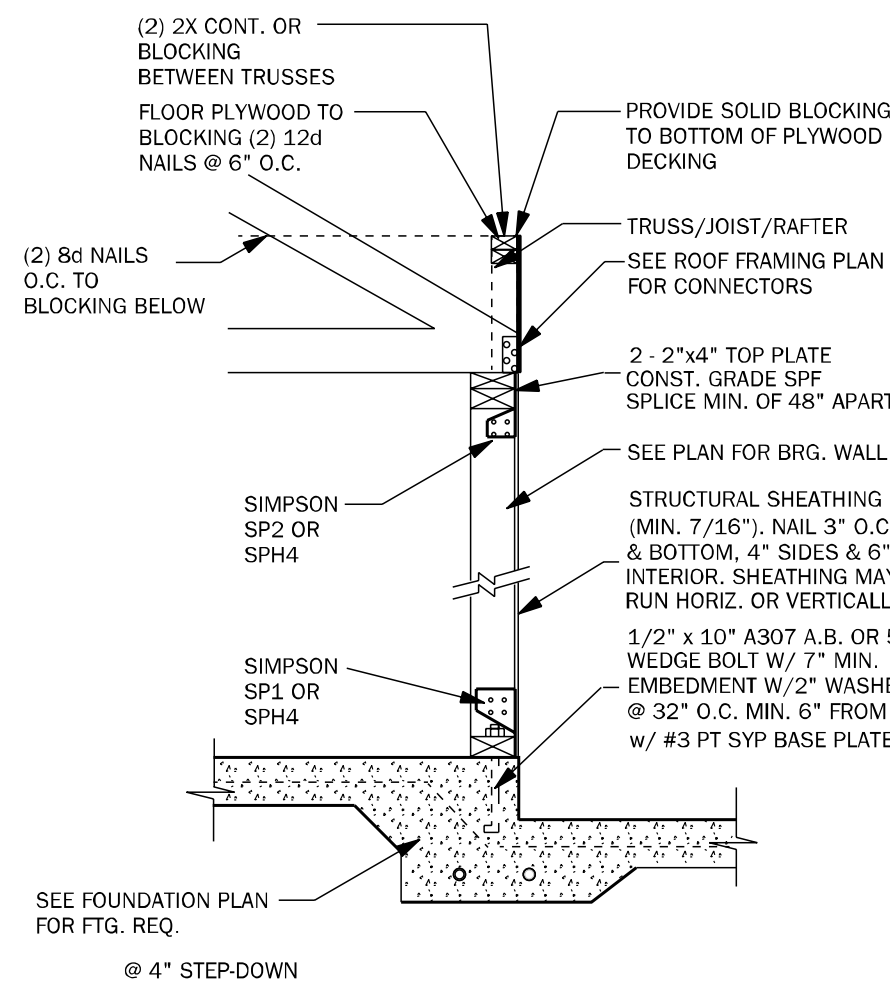


SW01 INTERIOR BEARING SHEARWALL w/UPLIFT N.T.S.

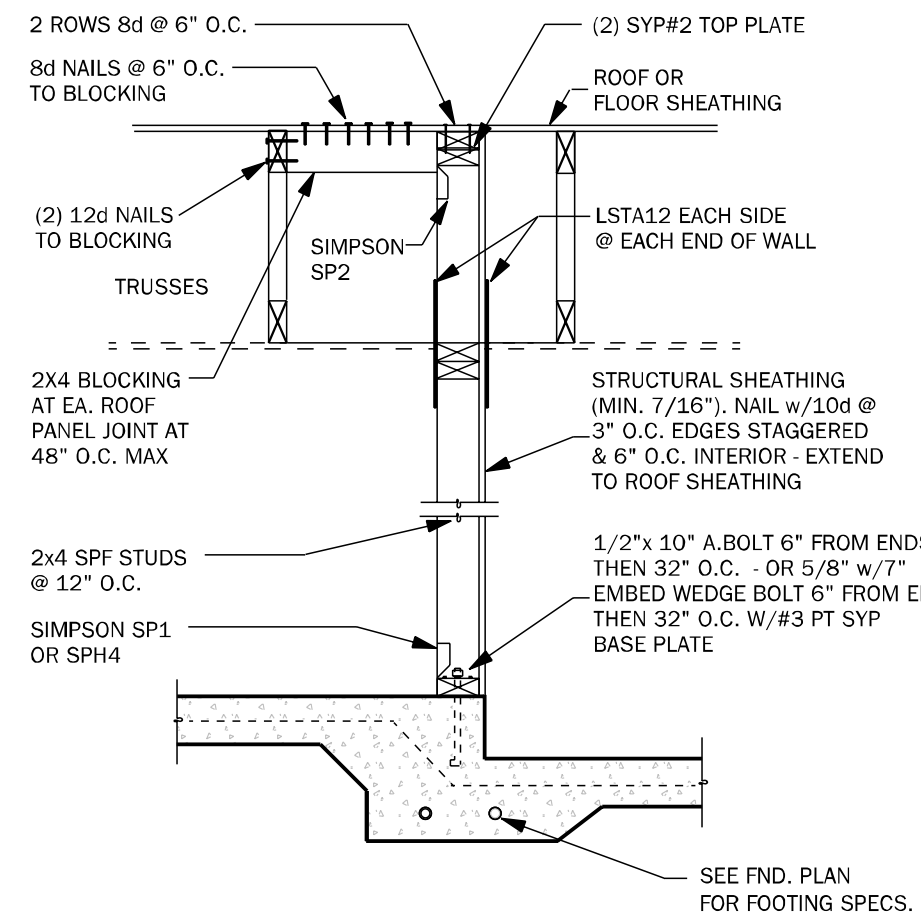

SW04 INTERIOR SHEARWALL @ TRUSSES 3/4" = 1'-0"

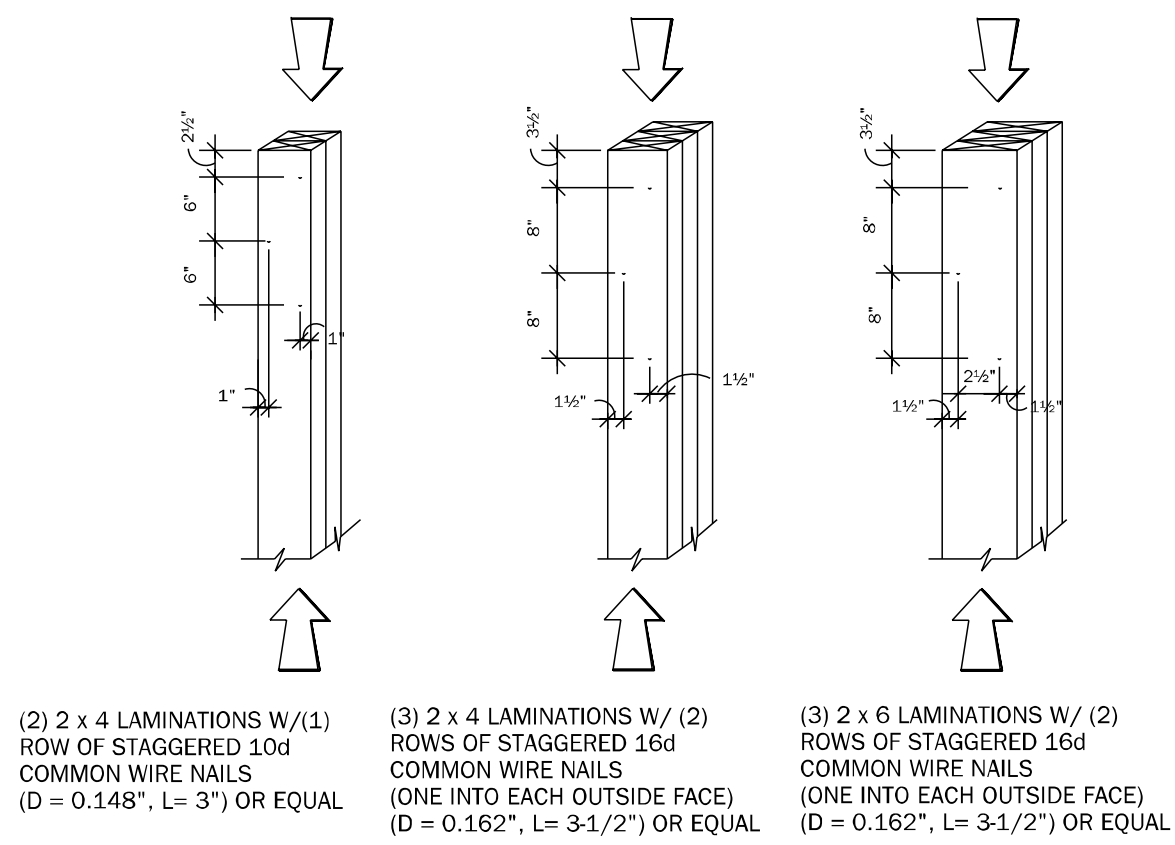

WF37 TYPICAL COLUMNS DETAILS N.T.S.

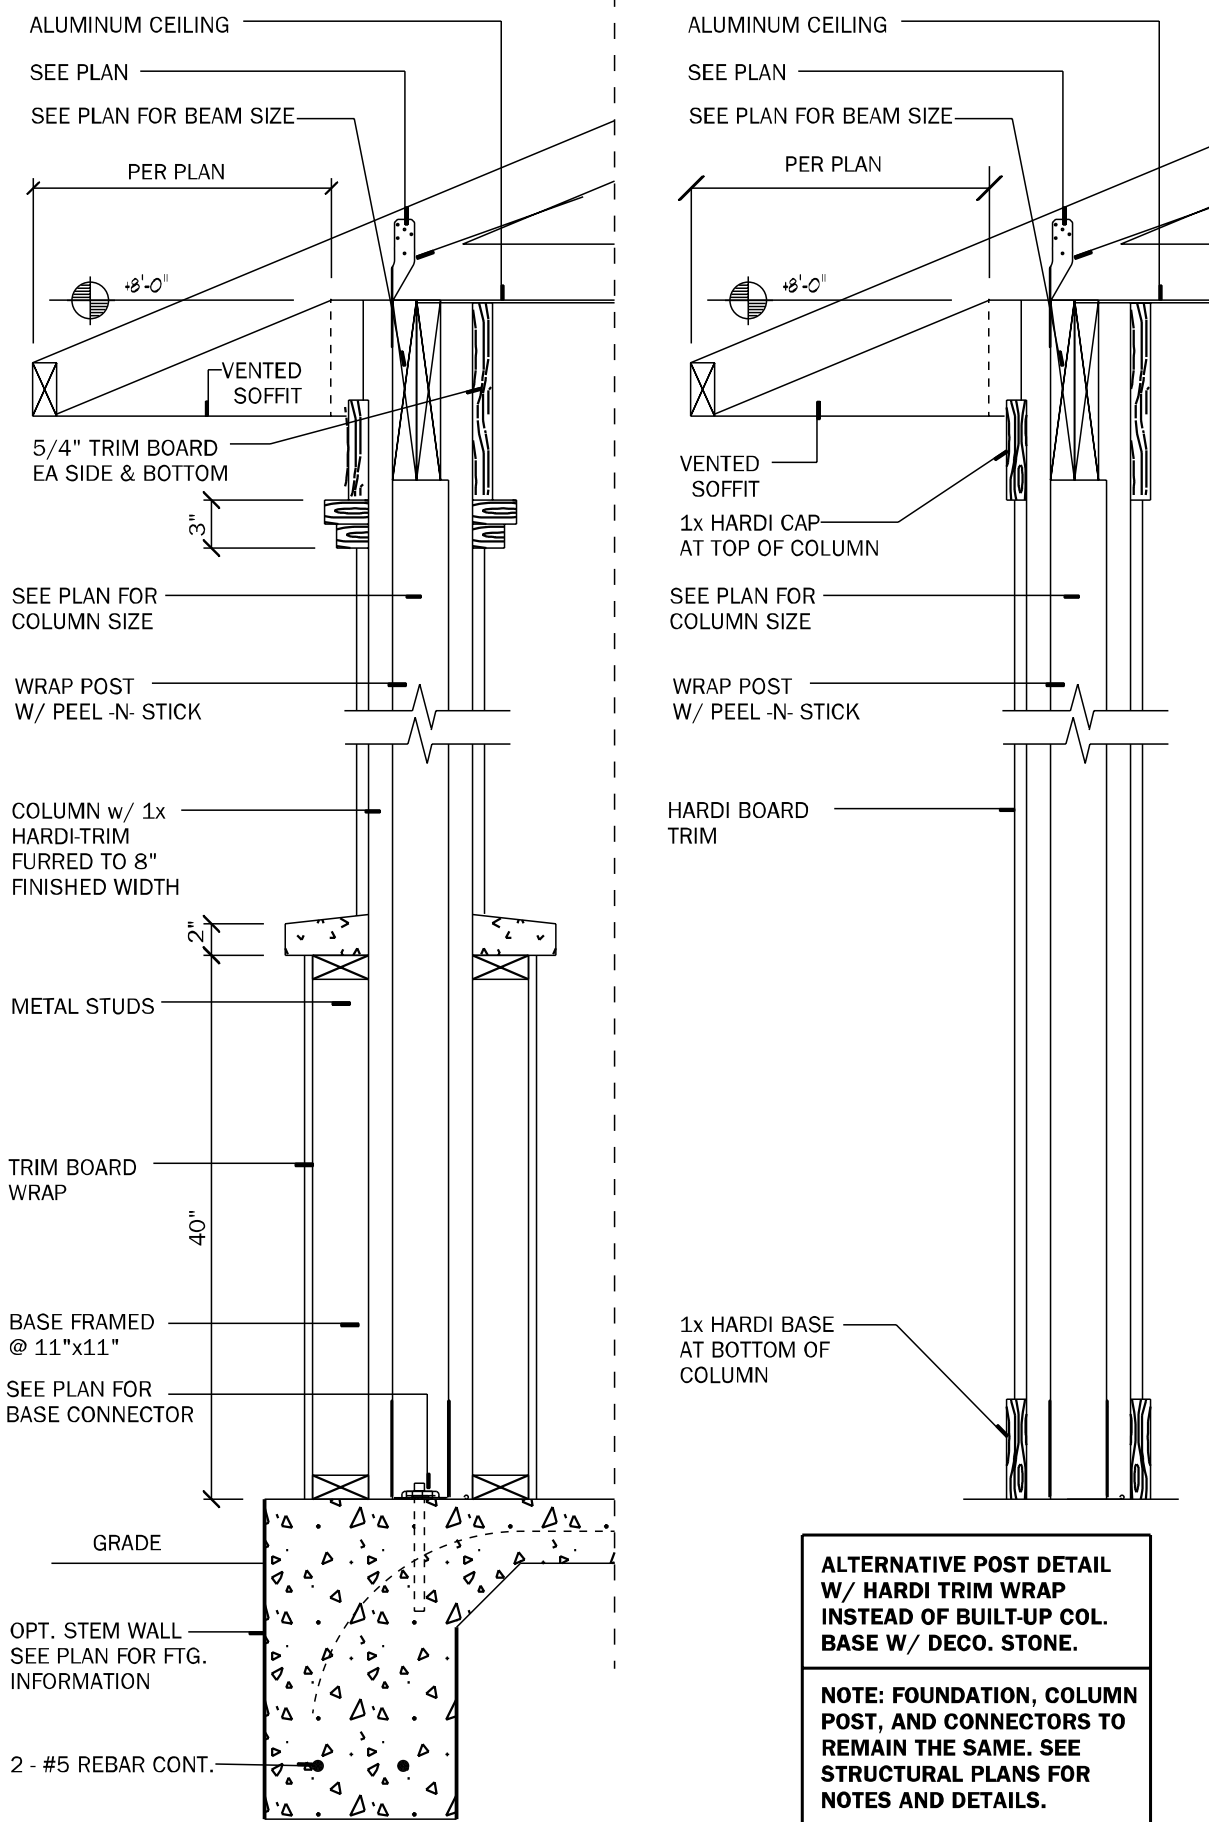

COLUMN OPTION 1 **COLUMN OPTION 2**

CD PORCH COLUMN DETAIL SCALE: 1" = 1'-0"

TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750
100% Employee Owned
myTSGhome.com

AIA **hba** **GO** **BA**

MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/17/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.

The document and/or the design contents expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright or intellectual property are reserved. The reproductions, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and International law.

Habitat for Humanity®
Greater Orlando & Osceola County
4116 Silver Star Rd.
Orlando, FL 32808
Office: (407) 648-4567
habitatofloridagreaterorlando.org

Builder:

UNIT:

BLK:

Community:

Plan Name: The DROSTE


Project Address:

Client No.:


S-3

TYPICAL WALL DETAILS

Project No: 25-06831
Sheet No:

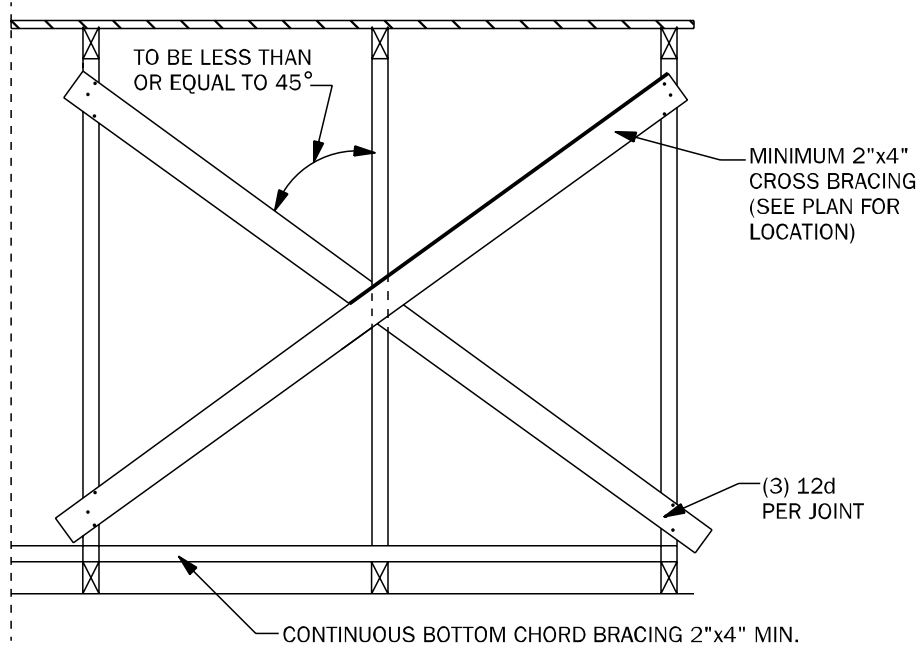


TB01 TYPICAL CROSS BRACING DETAIL N.T.S.

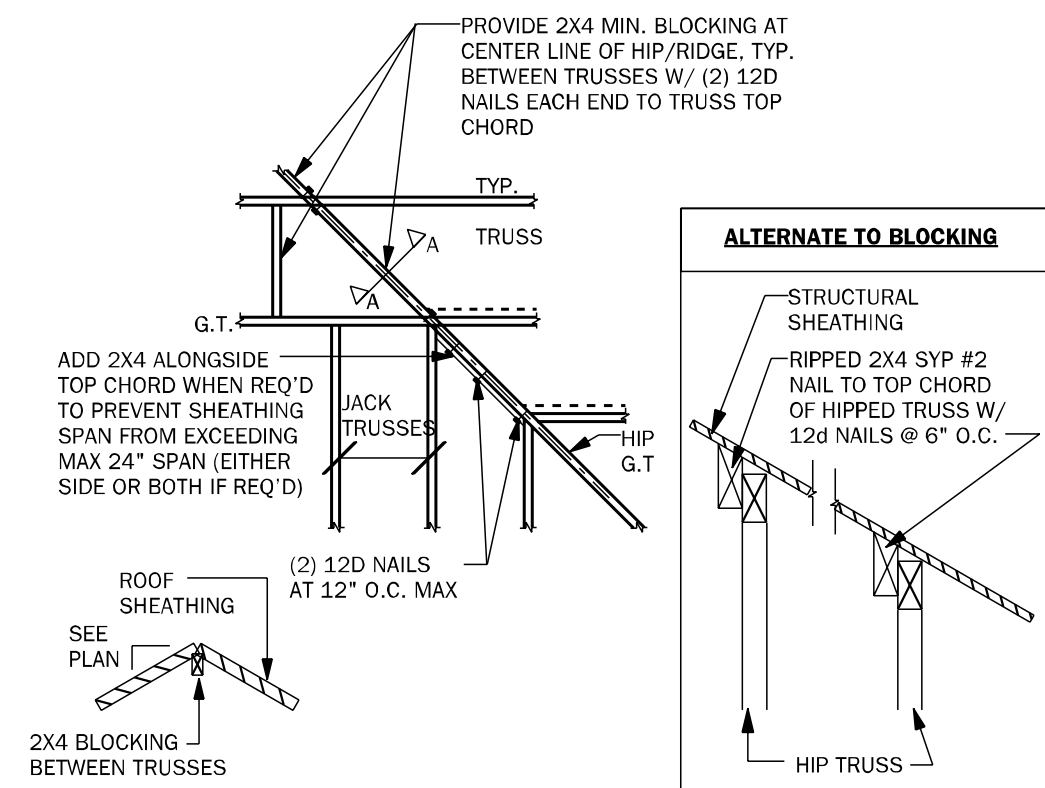

TB03 HIP / RIDGE BLOCKING DETAIL N.T.S.

TRUSS NOTES:


- WOOD TRUSS ERECTOR SHALL PROVIDE BRACING ACCORDING TO ANSI/TPI-2014 (TRUSS PLATE INSTITUTE) NOTE THAT THE COMBINED WIND AREA IS GREATER BEFORE THE ROOF SHEATHING IS APPLIED, AND BRACING SHALL THEREFORE BE INSTALLED AS THE TRUSSES ARE ERECTED. INADEQUATE BRACING IS THE MOST COMMON CAUSE OF ACCIDENT IN WOOD TRUSS CONSTRUCTION. FULL BUNDLES OF SHEATHING SHALL NOT BE PLACED ON TRUSSES. THIS CONSTRUCTION LOAD SHOULD BE LIMITED TO 8 SHEETS OF SHEATHING. ON ANY PAIR OF TRUSSES & SHALL BE LOCATED ADJACENT TO THE SUPPORTS. NO EXCESS CONCENTRATION OF ANY CONSTRUCTION MATERIAL (SUCH AS GRAVEL, OR SHINGLES) SHALL BE PLACED ON THE TRUSSES IN ANY ONE AREA THEY SHALL BE SPREAD OUT EVENLY OVER A LARGE AREA SO AS TO AVOID OVERLOADING ANY ONE TRUSS.
- ALL BRACING (DE OR BE) SHOWN ABOVE SHALL BE IN ADDITION TO CONTINUOUS LATERAL BRACING SPECIFIED BY THE TRUSS MANUFACTURER. ALL LATERAL BRACING SPECIFIED BY TRUSS MANUF. SHALL HAVE ADDITIONAL DIAGONAL BRACES AT 20'-0" O.C. MAXIMUM.
- ALL BRACES SHALL BE 2x4 NOMINAL DIMENSION LUMBER & SHALL BE ATTACHED W/ (3) 12d NAILS AT EACH TRUSS INTERSECTION.
- ADDITIONAL BOTTOM CHORD BRACING SHALL BE INSTALLED AS REQUIRED BY TRUSS DESIGN WHEREVER ADEQUATE STRUCTURAL CEILING ARE NOT ATTACHED DIRECTLY TO THE BOTTOM CHORD OF THE TRUSS.
- PROVIDE TRUSS BLOCKING AT ALL TRUSS BEARING SUPPORTS WHERE TRUSS DEPTH EXCEEDS STANDARD HEEL HEIGHT. SEE TYP. TRUSS BLOCKING DETAILS.

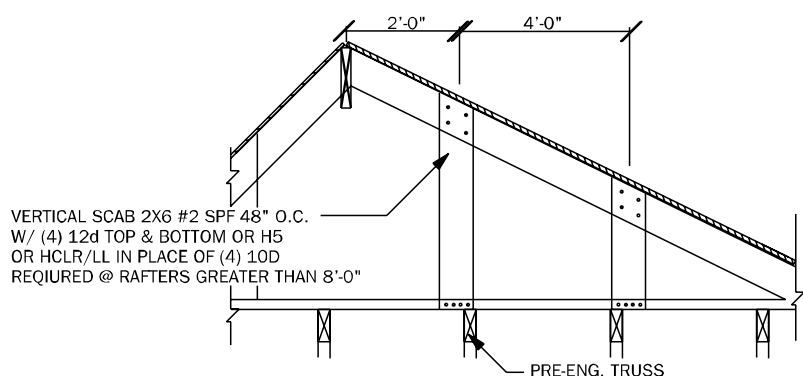


TYP. WOOD TRUSS BLOCKING @ RAISED HEEL DETAIL

TB06 BLOCKING AND CONVENTIONAL FRAME DETAILS 3/4" = 1'-0"


*DIAGONAL SPACED AT 20'-0" O.C. MAX
SAME SPACING AS BOTTOM CHORD LATERAL BRACING

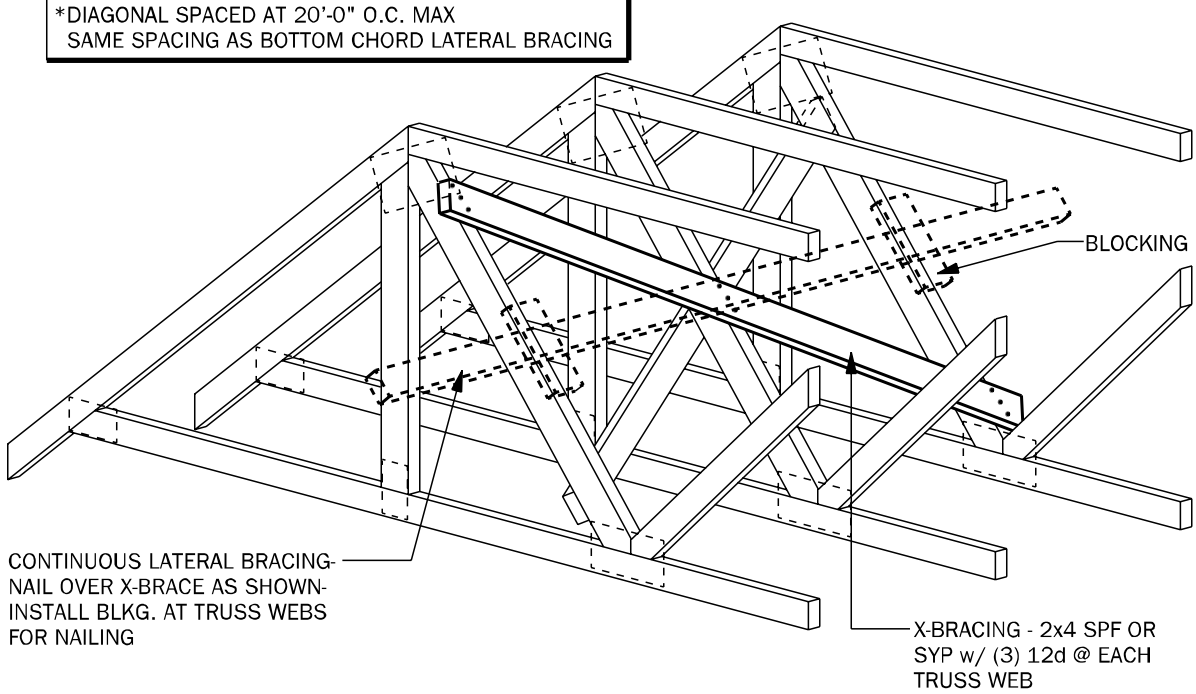


TB02 TYPICAL CROSS BRACING DETAIL N.T.S.

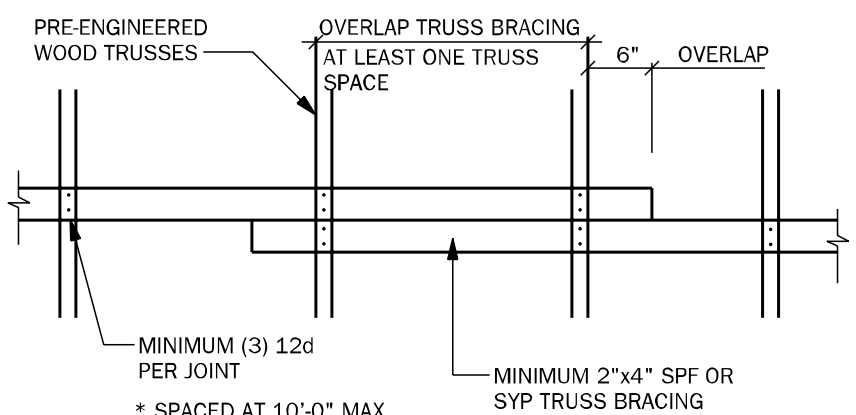


TB04 TRUSS BRACING OVERLAP DETAIL (TYP) N.T.S.

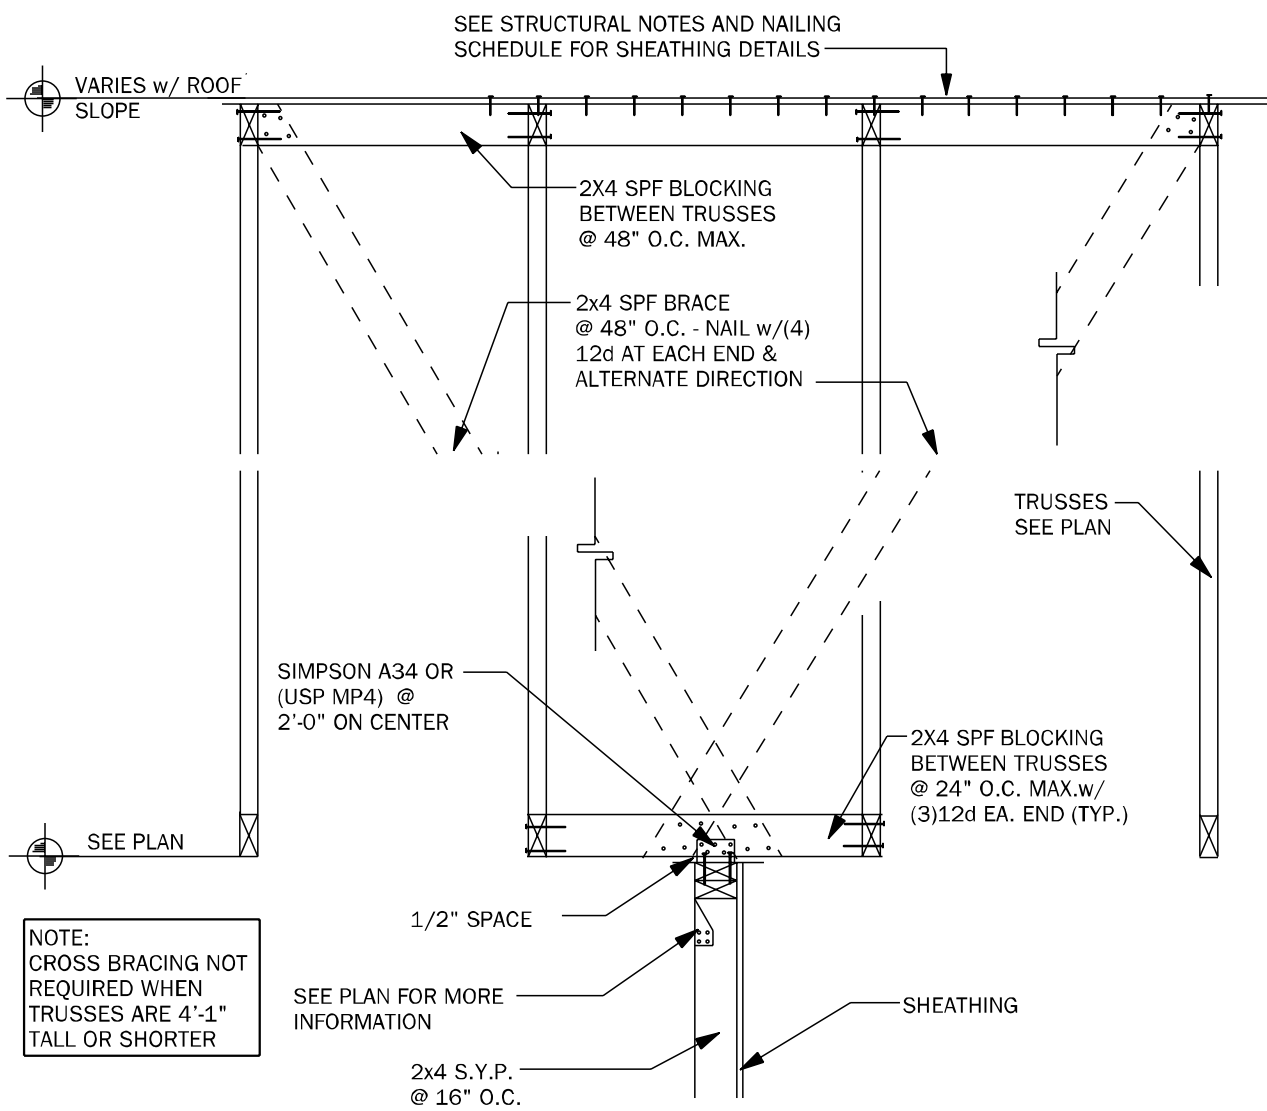

TB15 EXTERIOR NON-BEARING WALL DETAIL N.T.S.

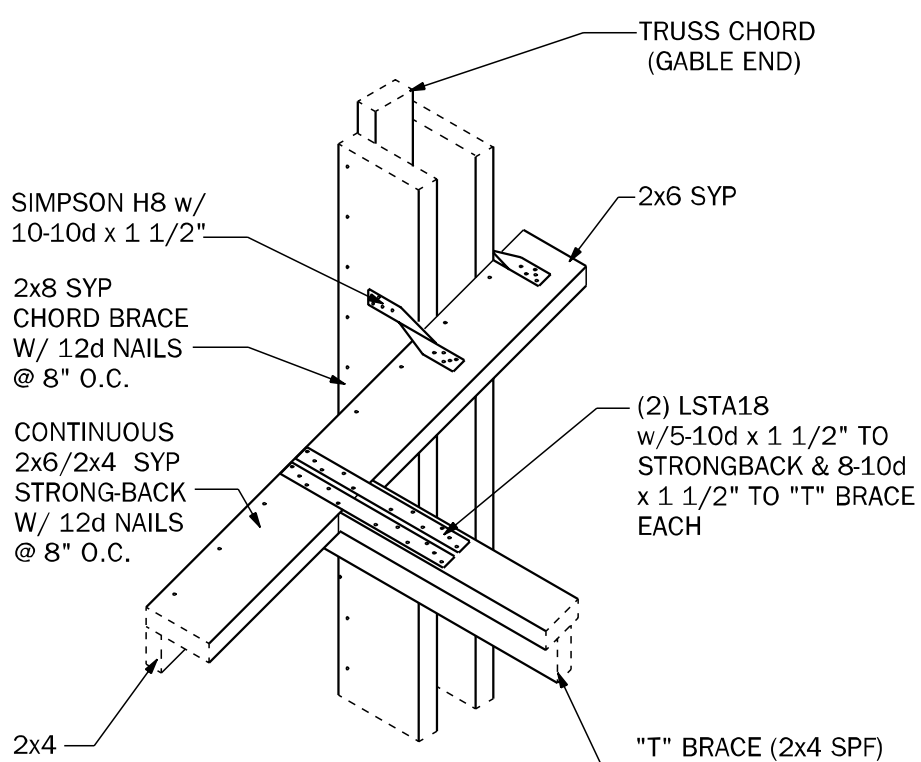


GE04 "T" BRACE CONNECTION @ GABLE END W/ VOLUME CEILING 3/4" = 1'-0"

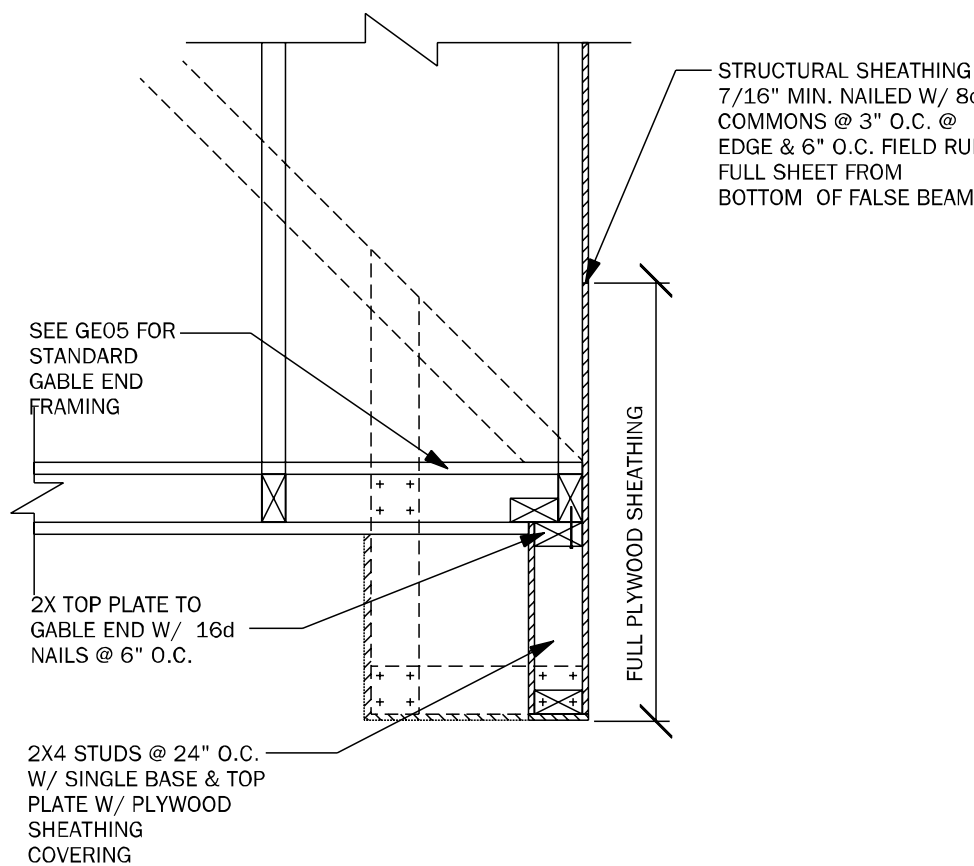


GE15 FALSE BEAM @ GABLE END 1/2" = 1'-0"

RAFTER SIZE


0'-8" SPAN - 2"x8" W/4-12d EACH END
8'-12" SPAN - 2"x8" W/4-12d EACH END
12'-15" SPAN - 2"x10" W/ SIMPSON A 34 @ EA. END
15'-18" SPAN - 2"x12" W/ SIMPSON A 34 @ EA. END

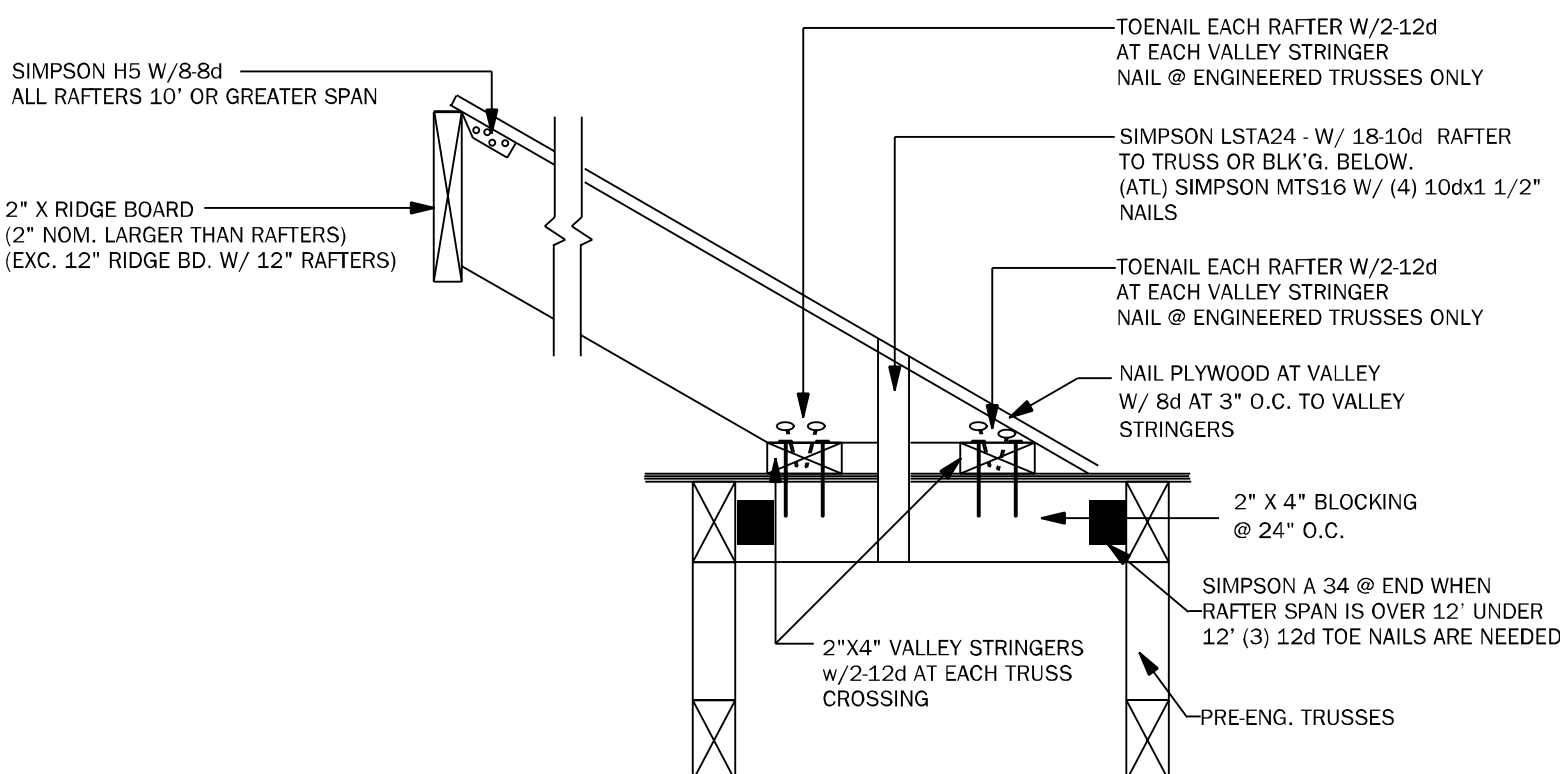

TB17 CONV. FRAMING & VALLEY FRAMING N.T.S.

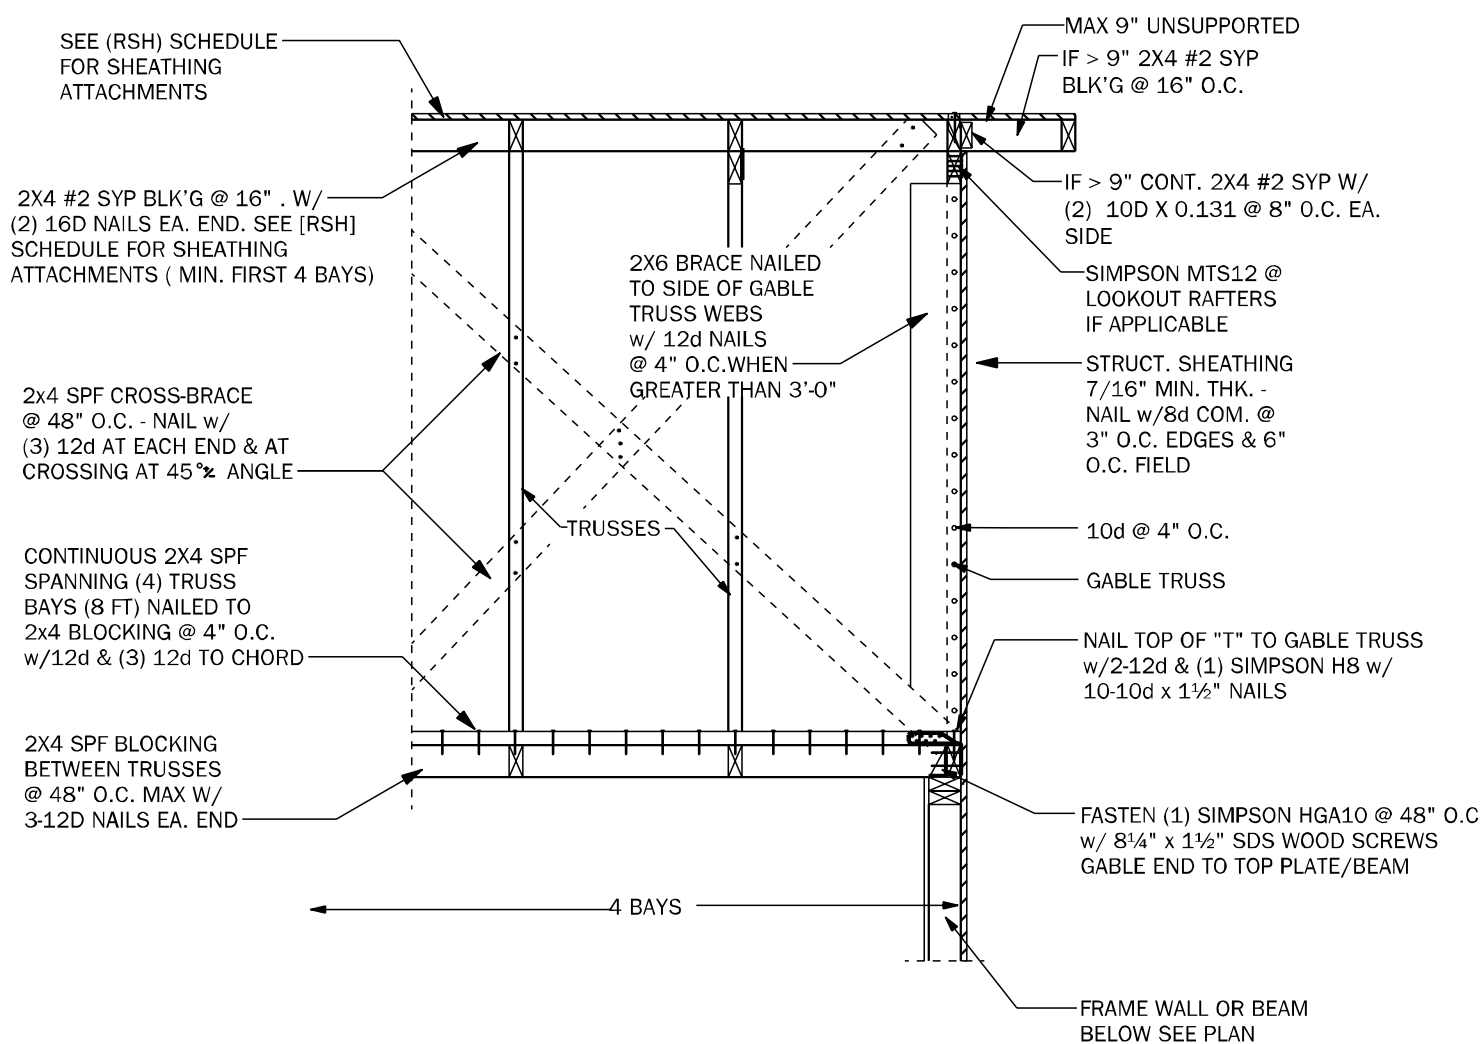

GE05 GABLE END BRACING - FRAME WALL N.T.S.

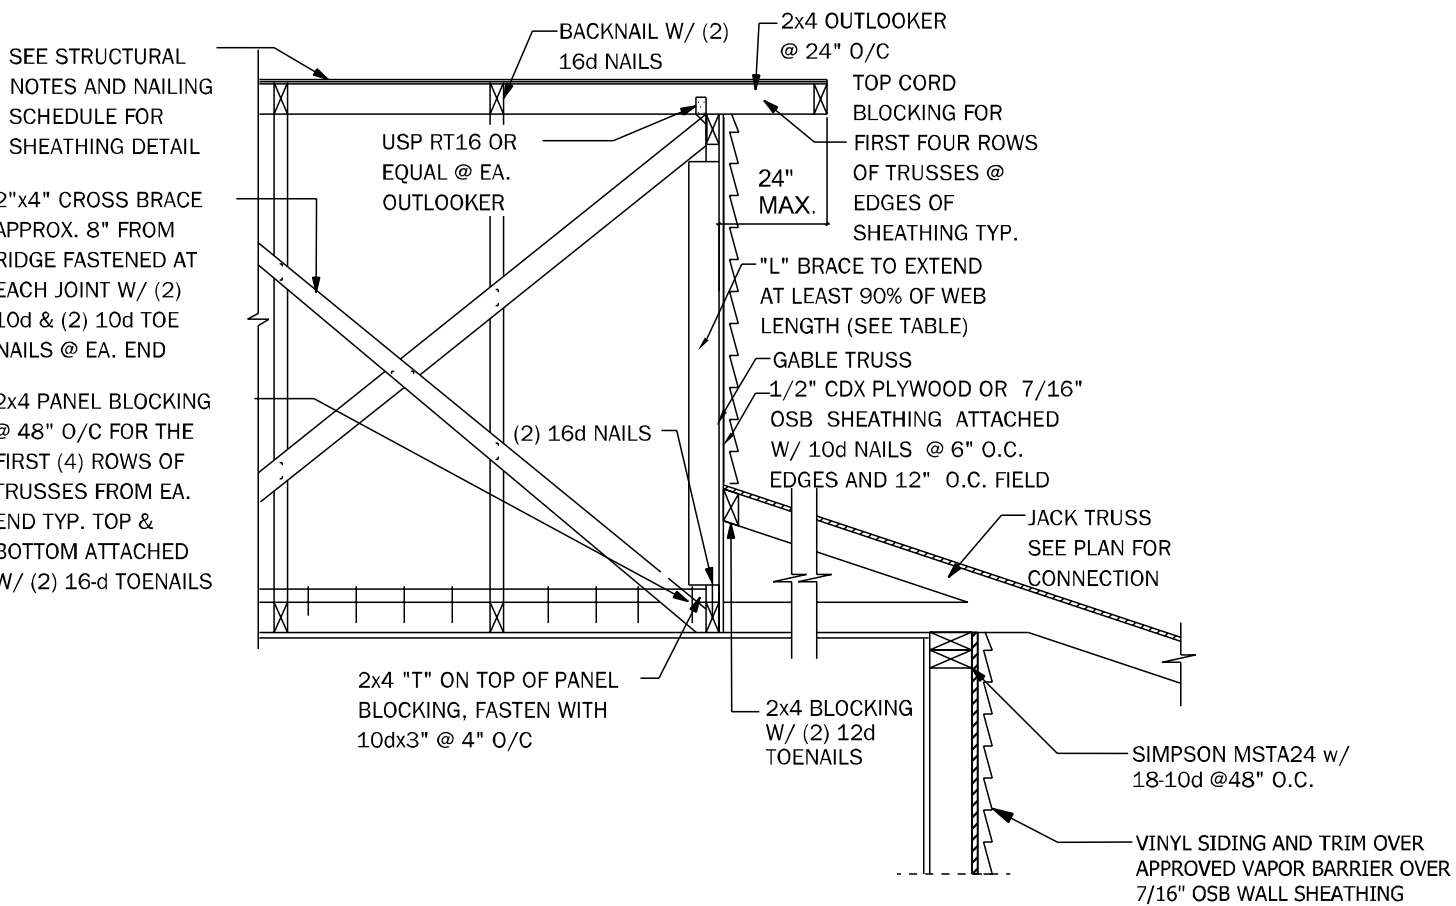

GE21 SECTION @ DUTCH GABLE 3/4" = 1'-0"

ISG
CA No. 9141
IAA260311E
Making Dreams Come True

TOTAL SOLUTIONS GROUP
258 Southhall Lane, Suite 200
Maitland, Florida, 32751
(407) 800-2333
CARL A. BROWN, PE - FL # 56126
SCOTT LEWKOWSKI, PE - FL #78750

100% Employee Owned
myTSGhome.com



MUNICIPAL STAMP AREA

SIGNATURE & SEAL
2/19/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Division. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.

This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright or intellectual property are reserved. The reproductions, copying or use of this document and/or the design concepts without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and International law.

Habitat for Humanity
Greater Orlando & Osceola County
4116 Silver Star Rd.
Orlando, FL 32808
Office: (407) 646-4667
habitatofcentralflorida.org

Builder: _____

COI:	BLK:	UNIT:
Community:		
Part Name:		
Project Address:		
Client No.:		

Project Name: **The DROSTIE**

MECHANICALLY FASTEN AS NECESSARY IN CORNERS THROUGH SELF-ADHERED FLASHING WEATHER RESISTIVE BARRIER TAPE FOLD UP WEATHER RESISTIVE BARRIER & TEMPORARILY SECURE EXTERIOR SHEATHING WEATHER RESISTIVE BARRIER SELF-ADHERED FLASHING HEAD FLASHING TIE-IN INSTRUCTIONS: 1. Cut, fold up & temporarily secure weather resistive barrier above header to allow for flashing installation 2. Self-adhered flashing plus head flashing under weather resistive barrier 3. Fold weather resistive barrier back over head flashing and seal with tape	WOOD FRAME CONSTR. SELF-ADHERED FLASHING BY LAPPING DOWN OVER RIM JOIST AND UP WALL BY 6 IN. WEATHER RESISTIVE BARRIER DOOR ROUGH OPENING 3/4"-1" BEAD OF CONSTR. ADHESIVE TO BE APPLIED UNDER THRESHOLD OF DOOR AND RETURN UP JAMB 6". USE LIQUID NAIL BRAND OR EQUAL WEATHER PROOF CAULKING SELF-ADHERED FLASHING SUBFLOOR RIM JOIST SEAL TOPS OF JOISTS UNDER DECKING (SEE DETAIL WP07)	SELF-ADHERED FLASHING PATCH SELF-ADHERED FLASHING SILL PLATE WALL SHEATHING WEATHER RESISTIVE BARRIER VINYL SIDING NOTES: 1. INSTALL WEATHER RESISTIVE BARRIER TO FORM WATER-SHEDDING LAPS. 2. FOR SILL PAN DEPTHS GREATER THAN 6 INCHES, A SLOPED SILL IS REQUIRED IN ACCORDANCE WITH ASTM E 2112 3. A BACK DAM CAN BE ACCOMPLISHED USING A WOODEN FURRING STRIP OR BY FOLDING THE ADHESIVE LAYER ONTO ITSELF. 4. EXTEND SELF-ADHERED FLASHING OVER NAILING FLANGE OF THE LAST COMPLETE COURSE OF SIDING PANEL AND TRIM TO PROTECT FROM PERMANENT EXPOSURE TO UV.	THESE DETAILS ARE GENERIC AND MEANT TO SHOW GENERAL FLASHING AND WATERPROOFING METHODS TO BE USED. SELF-ADHERED FLASHING PRODUCTS DETAILS WATER RESISTIVE BARRIERS ARE REQUIRED BEHIND STUCCO. PER FBCR (CURRENT EDITION) DETAIL INSTRUCTIONS REFER TO THE NUMBER MARKED AS ④ IN EACH DETAIL THAT CORRESPONDS TO THE NUMBERED ITEMS IN THE LIST OF INSTRUCTIONS BELOW: 1. INSTALL SELF-ADHERED FLASHING IN ORDER AS SHOWN BY NUMBERS. 2. INSTALL FLASHING AND WEATHER RESISTIVE BARRIER TO FORM WATER SHEDDING LAPS. 3. SELF-ADHERED FLASHING CAN BE SUBSTITUTED FOR BUILDING PAPER. 4. SPLIT THE RELEASE PAPER USING THE RIPCORD (SPLIT RELEASE ON DEMAND, EMBEDDED IN THE ADHESIVE LAYER) - FOR EASE OF INSTALLATION AND TO MINIMIZE SCORING CUTS. 5. REMOVE ALL RELEASE PAPER PER STANDARD INSTALLATION INSTRUCTIONS AND ADHERE TO SUBSTRATE USING A SQUARE PIECE OF FLASHING MATERIAL (6" X 6" MINIMUM). 6. FOLD AS SHOWN BY ARROWS. 7. ANGLE OF CORNER MAY VARY. ADJUST FOLDING OF THE FLASHING ACCORDINGLY TO FIT TIGHT TO CORNER. 8. MECHANICALLY FASTEN AS NECESSARY.
SELF-ADHERED FLASHING FLASHING INSTALLATION AFTER WEATHER RESISTIVE BARRIER Scale: NTS WP01	SELF-ADHERED FLASHING EXTERIOR DOOR WITH DECK - SECTION A WP02	TIE-IN WITH VINYL SIDING AT WINDOW SILL WP03	
EXTERIOR SHEATHING REFER TO TECHNICAL LETTER ON CHEMICAL COMPATIBILITY SELF-ADHERED FLASHING NAILING FLANGE DO NOT FLASH OVER BOTTOM NAILING FLANGE	3/4"-1" BEAD OF CONSTR. ADHESIVE TO BE APPLIED UNDER THRESHOLD OF DOOR AND RETURN UP JAMB 6". USE LIQUID NAIL BRAND OR EQUAL WEATHER PROOF CAULKING EXTERIOR SHEATHING INSTALL SELF-ADHERED FLASHING JAMB & HEAD FLASHING. SEE FLANGED WINDOW (SEE DETAIL WP01) SELF-ADHERED FLASHING. EXTEND A MINIMUM 6" VERTICALLY FROM BOTTOM OF THRESHOLD SECTION-A (SEE DETAIL WP02) SELF-ADHERED FLASHING SEAL TOPS OF JOISTS UNDER DECKING (SEE DETAIL WP07)	RUBBERIZED ASPHALT ADHESIVE SELF-ADHERED FLASHING SCORED RELEASE PAPER (BEFORE FOLDING, SCORE RELEASE PAPER TO EXPOSE ADHESIVE AS SHOWN) MECHANICALLY FASTEN AS NECESSARY IN CORNERS THROUGH SELF-ADHERED FLASHING	100% Employee Owned myTSGhome.com
SELF-ADHERED FLASHING HALF ROUND WINDOW WP04	SELF-ADHERED FLASHING EXTERIOR DOOR WITH DECK WP05	SELF-ADHERED FLASHING INSIDE CORNER WP06	1. EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION 703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH AAMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING: 1.1 THE FENESTRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE FENESTRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING OR WATER-RESISTIVE BARRIER MANUFACTURER'S INSTRUCTIONS. WHERE FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES. 1.2 IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL. 1.3 IN ACCORDANCE WITH OTHER APPROVED METHODS. 1.4 IN ACCORDANCE WITH FMA/AAMA 100, FMA/ AAMA 200, FMA/WDMA 250, FMA/AAMA/ WDMA 300 OR FMA/AAMA/WDMA 400 OR FMA/AAMA/WDMA 2710. 2. AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS. 3. UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS. 4. CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM. 5. WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION. 6. AT WALL AND ROOF INTERSECTIONS. 7. AT BUILT-IN GUTTERS.
SELF-ADHERED FLASHING DECK PROTECTOR SINGLE JOIST DOUBLE JOIST SELF-ADHERED FLASHING DECK PROTECTOR	SHEATHING SELF-ADHERED FLASHING PATCH SELF-ADHERED FLASHING 3" MIN		
SELF-ADHERED FLASHING 1/80.8362x;DECK JOIST WP07	SELF-ADHERED FLASHING OUTSIDE CORNER WP08		
SELF-ADHERED FLASHING WINDOW WITH NAILING FLANGE (SET IN SEALANT EXCEPT ALONG SILL FLANGE) WOOD BUCK SILL PLATE (SEE VCRDET-106 FOR OPTIONS) SELF-ADHERED FLASHING CORNER PATCH RECOMMENDED (SEE VCRDET-507 OR VCRDET-504 FOR OPTIONS) MECHANICALLY FASTEN AS NECESSARY IN CORNERS THROUGH SELF-ADHERED FLASHING NOTES: 1. INSTALL WINDOW PER MANUFACTURER'S RECOMMENDATION AND USE APPROPRIATE SEALANT FOR WINDOW AND WOOD BUCK 2. WEATHER RESISTIVE BARRIER TO FORM WATER-SHEDDING LAPS.	VINYL SIDING SELF-ADHERED FLASHING SIDING CORNER POST WOOD SIDING CORNER BOARDS NOTES: 1. EXTEND SELF-ADHERED FLASHING BEYOND JOINT BETWEEN SIDING AND CORNER POST/BOARDS. 2. INSTALL SELF-ADHERED FLASHING ON OUTSIDE CORNER FOR THE HEIGHT OF THE WALL.		
RECESSED WINDOW WP10	WALL-TO-WALL OUTSIDE CORNER WP11	WALL-TO-WALL INSIDE CORNER WP12	

FIGURE 1: FLASHING INSTALLATION

ASPHALT SEALANT: EXTEND MIN. OF 6" OUTSIDE OF FLASHING


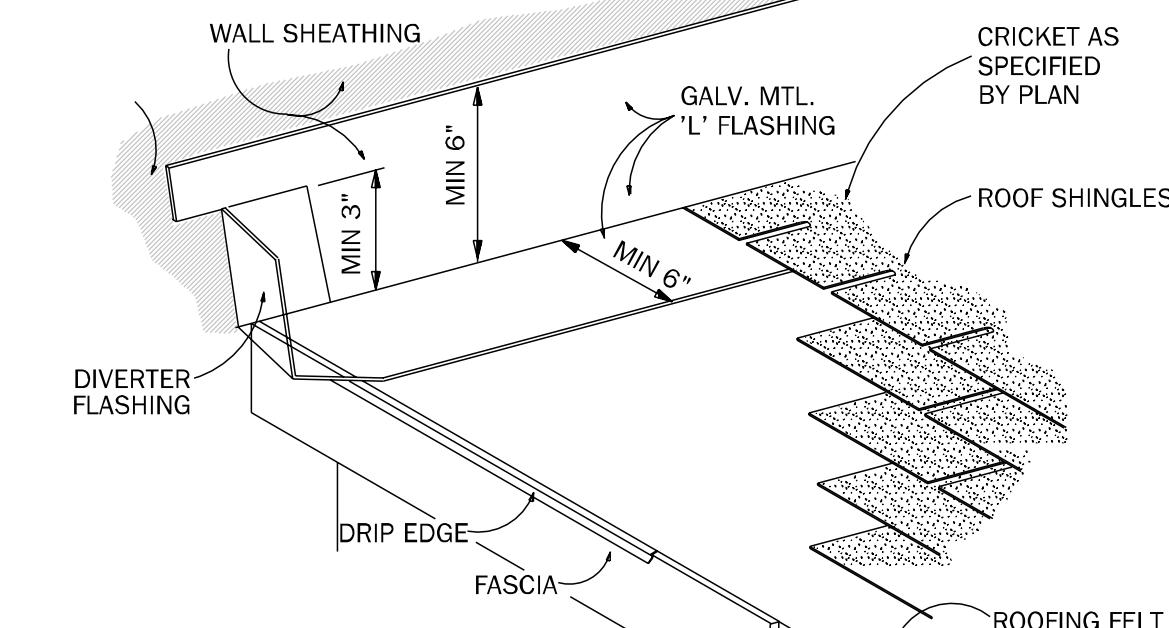


FIGURE 2: WALL FINISH

TEXTURED, PAINTED EXTERIOR WALL FINISH

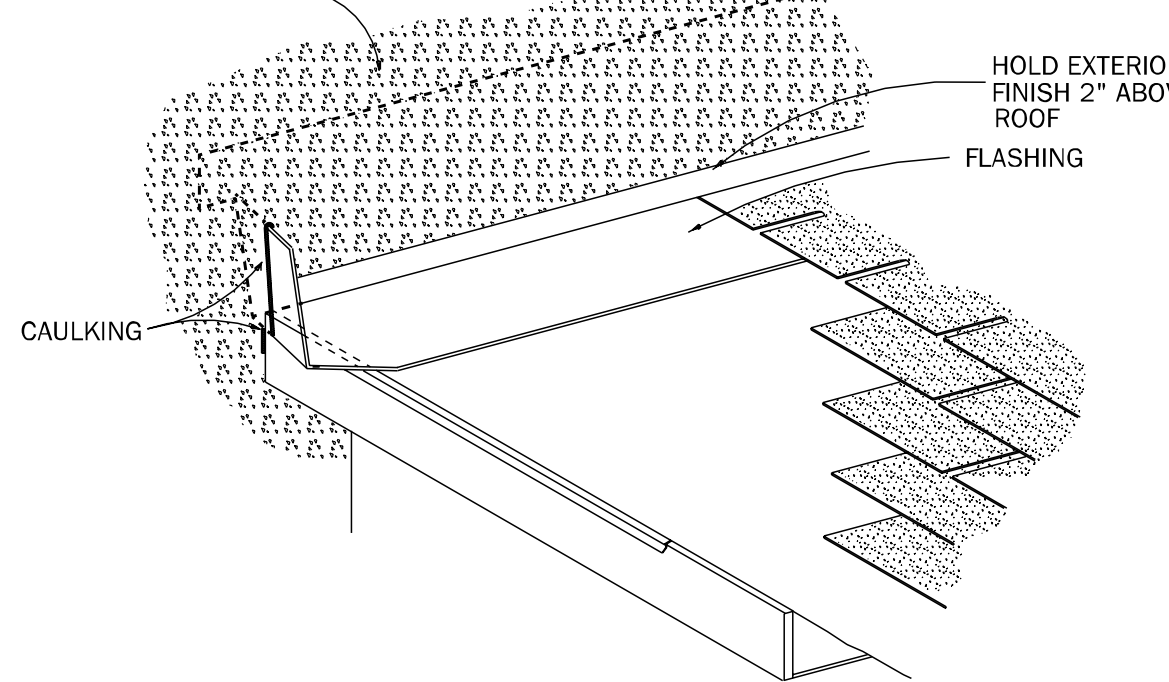

FLASHING INSTALLATION WHERE ROOF MEETS VERTICAL WALL

FLASHING REQUIREMENTS

R703.1 GENERAL. EXTERIOR WALLS SHALL PROVIDE THE BUILDING WITH A WEATHER-RESISTANT EXTERIOR WALL ENVELOPE. THE EXTERIOR WALL ENVELOPE SHALL INCLUDE FLASHING AS DESCRIBED IN SECTION R703.4.

R703.1.1 WATER RESISTANCE. THE EXTERIOR WALL ENVELOPE SHALL BE DESIGNED AND CONSTRUCTED IN AMANNER THAT PREVENTS THE ACCUMULATION OF WATER WITHIN THE WALL ASSEMBLY BY PROVIDING A WATER-RESISTANT BARRIER BEHIND THE EXTERIOR CLADDING AS REQUIRED BY SECTION R703.2 AND A MEANS OF DRAINING TO THE EXTERIOR WATER THAT PENETRATES THE EXTERIOR CLADDING.

R703.2 WATER-RESISTIVE BARRIER. NOT FEWER THAN ONE LAYER OF WATER-RESISTIVE BARRIER SHALL BE APPLIED OVER STUDS OR SHEATHING OF ALL EXTERIOR WALLS WITH FLASHING AS INDICATED IN SECTION R703.4. IN SUCH A MANNER AS TO PROVIDE A CONTINUOUS WATER-RESISTIVE BARRIER BEHIND THE EXTERIOR WALL VENER. THE WATER-RESISTIVE BARRIER MATERIAL SHALL BE CONTINUOUS TO THE TOP OF WALLS AND TERMINATED AT PENETRATIONS AND BUILDING APPENDAGES IN A MANNER TO MEET THE REQUIREMENTS OF THE EXTERIOR WALL ENVELOPE AS DESCRIBED IN SECTION R703.1. WATER-RESISTIVE BARRIER MATERIALS SHALL COMPLY WITH ONE OF THE FOLLOWING:

1. NO. 15 FELT COMPLYING WITH ASTM D226, TYPE 1.
2. ASTM E2568, TYPE 1 OR 2.
3. ASTM E331 IN ACCORDANCE WITH SECTION R703.1.1.

4. OTHER APPROVED MATERIALS IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. NO. 15 ASPHALT FELT AND WATER-RESISTIVE BARRIERS COMPLYING WITH ASTM E2556 SHALL BE APPLIED HORIZONTALLY, WITH THE UPPER LAYER LAPPED OVER THE LOWER LAYER NOT LESS THAN 2 INCHES (51MM), AND WHERE JOINTS OCCUR, SHALL BE LAPPED NOT LESS THAN 6 INCHES (152 MM).


R703.7.3 WATER-RESISTIVE BARRIERS WATER-RESISTIVE BARRIERS SHALL BE INSTALLED AS REQUIRED IN SECTION R703.2 AND, WHERE APPLIED OVER WOOD-BASED SHEATHING, SHALL INCLUDE A WATER-RESISTIVE VAPOR PERMEABLE BARRIER WITH A PERFORMANCE AT LEAST EQUIVALENT TO TWO LAYERS OF GRADE D PAPER. THE INDIVIDUAL LAYERS SHALL BE INSTALLED INDEPENDENTLY SUCH THAT EACH LAYER PROVIDES A SEPARATE CONTINUOUS PLANE AND ANY FLASHING (INSTALLED IN ACCORDANCE WITH SECTION R703.4) INTENDED TO DRAIN TO THE WATER-RESISTIVE BARRIER IS DIRECTED BETWEEN THE LAYERS.

EXCEPTION: WHERE THE WATER-RESISTIVE BARRIER THAT IS APPLIED OVER WOOD-BASED SHEATHING HAS A WATER RESISTANCE EQUAL TO OR GREATER THAN THAT OF 60-MINUTE GRADE D PAPER AND IS SEPARATED FROM THE STUCCO BY AN INTERVENING, SUBSTANTIALLY NONWATER-ABSORBING LAYER OR DESIGNED DRAINAGE SPACE.

R703.4 FLASHING. APPROVED METAL FLASHING, VINYL FLASHING, SELF-ADHERED MEMBRANES AND MECHANICALLY ATTACHED FLEXIBLE FLASHING SHALL BE APPLIED SHINGLE-FASHION OR IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. METAL FLASHING SHALL BE CORROSION RESISTANT. FLUID-APPLIED MEMBRANES USED AS FLASHING SHALL BE APPLIED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ALL FLASHING SHALL BE APPLIED IN A MANNER TO PREVENT THE ENTRY OF WATER INTO THE WALL CAVITY OR PENETRATION OF WATER TO THE BUILDING STRUCTURAL FRAMING COMPONENTS. SELF-ADHERED MEMBRANES USED AS FLASHING SHALL COMPLY WITH AAMA 711. ALL EXTERIOR PENETRATION PRODUCTS SHALL BE SEALED AT THE JUNCTURE WITH THE BUILDING WALL WITH A SEALANT COMPLYING WITH AAMA 800 OR ASTM C920 CLASS 25 GRADE NS OR GREATER FOR PROPER JOINT EXPANSION AND CONTRACTION. ASTM C1281, AAMA 812, OR OTHER APPROVED STANDARD AS APPROPRIATE FOR THE TYPE OF SEALANT. FLUID-APPLIED MEMBRANES USED AS FLASHING IN EXTERIOR WALLS SHALL COMPLY WITH AAMA 714. THE FLASHING SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH. APPROVED FLASHINGS SHALL BE INSTALLED AT THE FOLLOWING LOCATIONS:

1. EXTERIOR WINDOW AND DOOR OPENINGS. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL EXTEND TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER-RESISTIVE BARRIER COMPLYING WITH SECTION 703.2 FOR SUBSEQUENT DRAINAGE. MECHANICALLY ATTACHED FLEXIBLE FLASHINGS SHALL COMPLY WITH AAMA 712. FLASHING AT EXTERIOR WINDOW AND DOOR OPENINGS SHALL BE INSTALLED IN ACCORDANCE WITH ONE OR MORE OF THE FOLLOWING:
 - 1.1 THE FENESTRATION MANUFACTURER'S INSTALLATION AND FLASHING INSTRUCTIONS, OR FOR APPLICATIONS NOT ADDRESSED IN THE FENESTRATION MANUFACTURER'S INSTRUCTIONS, IN ACCORDANCE WITH THE FLASHING OR WATER-RESISTIVE BARRIER MANUFACTURER'S INSTRUCTIONS. WHERE FLASHING INSTRUCTIONS OR DETAILS ARE NOT PROVIDED, PAN FLASHING SHALL BE INSTALLED AT THE SILL OF EXTERIOR WINDOW AND DOOR OPENINGS. PAN FLASHING SHALL BE SEALED OR SLOPED IN SUCH A MANNER AS TO DIRECT WATER TO THE SURFACE OF THE EXTERIOR WALL FINISH OR TO THE WATER RESISTIVE BARRIER FOR SUBSEQUENT DRAINAGE. OPENINGS USING PAN FLASHING SHALL INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES.
 - 1.2 IN ACCORDANCE WITH THE FLASHING DESIGN OR METHOD OF A REGISTERED DESIGN PROFESSIONAL.
 - 1.3 IN ACCORDANCE WITH OTHER APPROVED METHODS.
 - 1.4 IN ACCORDANCE WITH FMA/AAMA 100, FMA/ AAMA 200, FMA/WDMA 250, FMA/AAMA/ WDMA 300 OR FMA/AAMA/WDMA 400 OR FMA/AAMA/WDMA 2710.
2. AT THE INTERSECTION OF CHIMNEYS OR OTHER MASONRY CONSTRUCTION WITH FRAME OR STUCCO WALLS, WITH PROJECTING LIPS ON BOTH SIDES UNDER STUCCO COPINGS.
3. UNDER AND AT THE ENDS OF MASONRY, WOOD OR METAL COPINGS AND SILLS.
4. CONTINUOUSLY ABOVE ALL PROJECTING WOOD TRIM.
5. WHERE EXTERIOR PORCHES, DECKS OR STAIRS ATTACH TO A WALL OR FLOOR ASSEMBLY OF WOOD-FRAME CONSTRUCTION.
6. AT WALL AND ROOF INTERSECTIONS.
7. AT BUILT-IN GUTTERS.

FIGURE 3: CORNER DETAIL

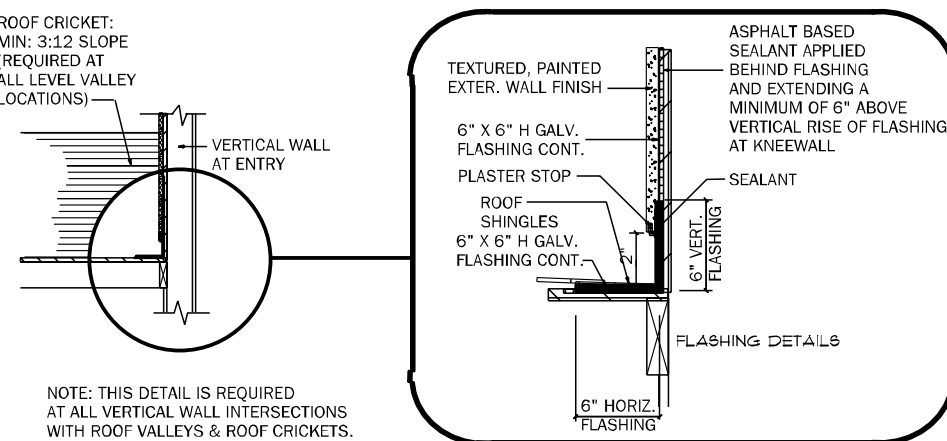

FLASHING DETAIL AT CRICKET / KNEEWALL INTERSECTION

TOTAL SOLUTIONS GROUP
 258 Southhall Lane, Suite 200
 Maitland, Florida, 32751
 (407) 800-2333
 SCOTT A. BROWN, PE - FL # 58126
 CAROL LEWKOWSKI, PE - FL # 87850

100% Employee Owned
 myTSGhome.com

AIA
 B.D.

ATA
 fhba
 GO
 BA

MUNICIPAL STAMP AREA
 SIGNATURE & SEAL
 2/19/2026

To the best of the Engineer's knowledge, information and belief, the structural plans and specifications contain within these drawings comply with the 2023 Florida Building Code, Residential Edition. Engineer's signature and seal is only for the structural engineering portions of the drawing pages bearing engineer's signature and seal.

This document and/or the design concepts expressed herein are the property of TSG (Total Solutions Group) and all rights of ownership, including copyright or intellectual property are reserved. The reproduction, copying, or use of this document and/or the design concept without the written consent of TSG (Total Solutions Group) is strictly prohibited and protected by United States and international law.

Habitat for Humanity
 Greater Orlando & Osceola County
 4116 Silver Star Rd.
 Orlando, FL 32808
 office: (407) 648-4567
 habitat@osceola.org

Builder:

UNIT:

BLK:

Community:

Plan Name: **The DROSTE**
 Project Address:

Client No:

Project No: 25-06831
 Sheet No:

WP
 WATER PROOF DETAILS